

REFERENCE DATA SERIES No. 2
2012 Edition

Nuclear Power Reactors in the World



IAEA

International Atomic Energy Agency

REFERENCE DATA SERIES No. 2

NUCLEAR POWER REACTORS IN THE WORLD

2012 Edition

INTERNATIONAL ATOMIC ENERGY AGENCY
VIENNA, 2012

NUCLEAR POWER REACTORS IN THE WORLD
IAEA, VIENNA, 2012
IAEA-RDS-2/31
ISBN 978-92-0-132310-1
ISSN 1011-2642

Printed by the IAEA in Austria
June 2012

CONTENTS

Introduction	5
Definitions	7
Table 1. Reactors in operation, in long term shutdown and under construction, 31 Dec. 2011	10
Table 2. Type and net electrical power of reactors connected to the grid, 31 Dec. 2011	12
Table 3. Type and net electrical power of reactors under construction, 31 Dec. 2011	13
Table 4. Reactor years of experience, up to 31 Dec. 2011	14
Table 5. Operating reactors and net electrical power, 1980 to 2011	16
Table 6. Nuclear electricity production and share, 1980 to 2011	18
Table 7. Annual construction starts and connections to the grid, 1954 to 2011	20
Table 8. Number of new reactors connected to the grid and median construction time in months	21
Table 9. Construction starts during 2011	22
Table 10. Connections to the grid during 2011	23
Table 11. Scheduled connections to the grid during 2012	23
Table 12. Reactors planned for construction as known on 31 Dec. 2011	24
Table 13. Reactors under construction, 31 Dec. 2011	28
Table 14. Reactors in operation, 31 Dec. 2011	31
Table 15. Reactors in long term shutdown, 31 Dec. 2011	47
Table 16. Reactors permanently shut down, 31 Dec. 2011	48
Table 17. Reactors in decommissioning process or decommissioned, 31 Dec. 2011	53

Table 18.	Performance factors by reactor category, 2009 to 2011	58
Table 19.	Full outage statistics during 2011	59
Table 20.	Direct causes of full outages during 2011	60
Table 21.	Direct causes of full outages, 2007 to 2011	61
Table 22.	Countries: abbreviations and summary . .	62
Table 23.	Reactor types: abbreviations and summary	64
Table 24.	Operators: abbreviations and summary .	65
Table 25.	NSSS suppliers: abbreviations and summary	71
Figure 1.	Number of operational reactors by type and net electrical power (as of 31 Dec. 2011)	74
Figure 2.	Reactors under construction by type and net electrical power (as of 31 Dec. 2011)	75
Figure 3.	Nuclear share of electricity generation (as of 31 Dec. 2011)	76
Figure 4.	Worldwide median construction time in months (as of 31 Dec. 2011)	77
Figure 5.	Number of reactors in operation by age (as of 31 Dec. 2011)	78
Figure 6.	Annual construction starts and connections to the grid, 1954 to 2011	79

INTRODUCTION

Nuclear Power Reactors in the World is an annual publication that presents the most recent data pertaining to nuclear power reactors in IAEA Member States.

This thirty-second edition of Reference Data Series No. 2 provides a detailed comparison of various statistics through 31 December 2011. The tables and figures contain the following information:

- General statistics on nuclear reactors in IAEA Member States;
- Technical data on specific reactors that are either planned, under construction or operational, or that have been shut down or decommissioned.
- Performance data on reactors operating in IAEA Member States, as reported to the IAEA.

The data compiled in this publication is a product of the IAEA's Power Reactor Information System (PRIS). The PRIS database is a comprehensive source of data on all nuclear power reactors in the world. It includes specification and performance history data on operational reactors as well as on reactors under construction or in the decommissioning process. The IAEA collects this data through designated national correspondents in Member States.

PRIS outputs are available in the IAEA's annual publications and on the PRIS web page (<http://www.iaea.org/pris>). Detailed outputs are accessible to registered users through on-line applications. Enquiries should be addressed to:

Director
Division of Nuclear Power
International Atomic Energy Agency
Vienna International Centre
PO Box 100
1400 Vienna, Austria
Email: PrisAdmin@iaea.org

DEFINITIONS

Performance factors

$$\text{EAF (\%)} = \frac{(\text{REG} - \text{PEL} - \text{UEL} - \text{XEL})}{\text{REG}} \times 100$$

$$\text{UCF (\%)} = \frac{(\text{REG} - \text{PEL} - \text{UEL})}{\text{REG}} \times 100$$

$$\text{UCL (\%)} = \frac{\text{UEL}}{\text{REG}} \times 100$$

$$\text{PCL (\%)} = \frac{\text{PEL}}{\text{REG}} \times 100$$

$$\text{LF (\%)} = \frac{\text{EG}}{\text{REG}} \times 100$$

$$\text{OF (\%)} = \frac{\text{On-line Hours}}{\text{Total Hours}} \times 100$$

where

EAF is the energy availability factor, expressed in per cent.

UCF is the unit capability factor, expressed in per cent.

UCL is the unplanned capability loss factor, expressed in per cent.

PCL is the planned capability loss factor, expressed in per cent.

LF is the load factor, expressed in per cent.

OF is the operating factor, expressed in per cent.

REG reference energy generation: The net electrical energy (MW·h) supplied by a unit continuously operated at the reference unit power during the entire reference period.

- PEL planned energy loss: The energy (MW·h) that was not supplied during the period because of planned shutdowns or load reductions due to causes under plant management control. Energy losses are considered to be planned if they are scheduled at least four weeks in advance.
- UEL unplanned energy loss: The energy (MW·h) that was not supplied during the period because of unplanned shutdowns, outage extensions, or load reductions due to causes under plant management control. Energy losses are considered to be unplanned if they are not scheduled at least four weeks in advance.
- XEL external energy loss: The energy (MW·h) that was not supplied due to constraints beyond plant management control that reduced plant availability.
- EG the net electrical energy supplied during the reference period as measured at the unit outlet terminals after deducting the electrical energy taken by unit auxiliaries and the losses in transformers that are considered to be integral parts of the unit.

Construction Start

Date when first major placing of concrete, usually for the base mat of the reactor building, is done.

First Criticality

Date when the reactor is made critical for the first time.

Grid Connection

Date when the plant is first connected to the electrical grid for the supply of power. After this date, the plant is considered to be in operation.

Commercial Operation

Date when the plant is handed over by the contractors to the owner and declared to be officially in commercial operation.

Permanent Shutdown

Date when the plant is officially declared to be shut down by the owner and taken out of operation permanently.

Long Term Shutdown

A unit is considered to be in long term shutdown status if it has been shut down for an extended period (usually several years) without any firm recovery schedule at the beginning, but there is the intention to restart the unit eventually.

Units and Energy Conversion

1 terawatt-hour (TW·h) = 10^6 megawatt-hours (MW·h).

For an average power plant,

1 TW·h = 0.39 megatonnes of coal equivalent (input)
= 0.23 megatonnes of oil equivalent (input).

TABLE 1. REACTORS IN OPERATION, IN LONG TERM SHUTDOWN AND UNDER CONSTRUCTION, 31 DEC. 2011

Country	Reactors in operation		Reactors in long term shutdown		Reactors under construction		Nuclear electricity supplied in 2011	
	No. of Units	Total MW(e)	No. of Units	Total MW(e)	No. of Units	Total MW(e)	TW(e)·h	% of total
ARGENTINA	2	935			1	692	5.9	5.0
ARMENIA	1	375					2.4	33.2
BELGIUM	7	5927					45.9	54.0
BRAZIL	2	1884			1	1245	14.8	3.2
BULGARIA	2	1906			2	1906	15.3	32.6
CANADA	18	12604	4	2726			88.3	15.3
CHINA	16	11816			26	26620	82.6	1.9
CZECH REP.	6	3766					26.7	33.0
FINLAND	4	2736			1	1600	22.3	31.6
FRANCE	58	63130			1	1600	423.5	77.7
GERMANY	9	12068					102.3	17.8
HUNGARY	4	1889					14.7	43.3
INDIA	20	4391			7	4824	3.7	3.7
IRAN, ISL. REP.	1	915					0.1	0.0
JAPAN	50	44215			2	2650	156.2	18.1
KOREA, REP. OF	21	18751	1	246	5	5560	147.8	34.6
MEXICO	2	1300					9.3	3.6
NETHERLANDS	1	482					3.9	3.6
PAKISTAN	3	725			2	630	3.8	3.8
ROMANIA	2	1300					10.8	19.0
RUSSIA	33	23643			10	8188	162.0	17.6
SLOVAKIA	4	1816			2	782	14.3	54.0
SLOVENIA	1	688					5.9	41.7
SOUTH AFRICA	2	1830					12.9	5.2
SPAIN	8	7567					55.1	19.5
SWEDEN	10	9326					58.1	39.6
SWITZERLAND	5	3263					25.7	40.9
UK	18	9953					62.7	17.8

TABLE 1. REACTORS IN OPERATION, IN LONG TERM SHUTDOWN AND UNDER CONSTRUCTION, 31 DEC. 2011 — continued

Country	Reactors in operation		Reactors in long term shutdown		Reactors under construction		Nuclear electricity supplied in 2011	
	No. of Units	Total MW(e)	No. of Units	Total MW(e)	No. of Units	Total MW(e)	TW(e)·h	% of total
UKRAINE	15	13107			2	1900	84.9	47.2
USA	104	101465			1	1165	790.4	19.3
Total	435	368791	5	2972	65	61962	2518.0	NA

Note: The total includes the following data from Taiwan, China:

— 6 units, 5018 MW in operation; 2 units, 2600 MW under construction;

— 40.37 TW(e)·h of nuclear electricity generation, representing 19.02% of the total electricity generated there.

TABLE 2. TYPE AND NET ELECTRICAL POWER OF REACTORS CONNECTED TO THE GRID, 31 DEC. 2011

Country	PWR		BWR		GCR		PHWR		LWGR		FBR		Total	
	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)
ARGENTINA							2	935					2	935
ARMENIA	1	375											1	375
BELGIUM	7	5927											7	5927
BRAZIL	2	1884											2	1884
BULGARIA	2	1906											2	1906
CANADA							18	12604					18	12604
CHINA	13	10496					2	1300			1	20	16	11816
CZECH REP.	6	3766											6	3766
FINLAND	2	976	2	1760									4	2736
FRANCE	58	63130											58	63130
GERMANY	7	9496	2	2572									9	12068
HUNGARY	4	1889											4	1889
INDIA			2	300			18	4091					20	4391
IRAN, ISL. REP.	1	915											1	915
JAPAN	24	19284	26	24931									50	44215
KOREA, REP. OF	17	15966					4	2785					21	18751
MEXICO			2	1300									2	1300
NETHERLANDS	1	482											1	482
PAKISTAN	2	600					1	125					3	725
ROMANIA							2	1300					2	1300
RUSSIA	17	12864							15	10219	1	560	33	23643
SLOVAKIA	4	1816											4	1816
SLOVENIA	1	688											1	688
SOUTH AFRICA	2	1830											2	1830
SPAIN	6	6057	2	1510									8	7567
SWEDEN	3	2811	7	6515									10	9326
SWITZERLAND	3	1700	2	1563									5	3263
UK	1	1191			17	8762							18	9953
UKRAINE	15	13107											15	13107
USA	69	67368	35	34097									104	101465
TOTAL	270	248364	84	77726	17	8762	47	23140	15	10219	2	580	435	368791

Note: The totals include 6 units, 5018 MW in Taiwan, China.
 During 2011, 7 reactors, 4004 MW were newly connected to the grid.

TABLE 3. TYPE AND NET ELECTRICAL POWER OF REACTORS UNDER CONSTRUCTION, 31 DEC. 2011

Country	PWR		BWR		PHWR		LWGR		FBR		Total	
	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)
ARGENTINA					1	692					1	692
BRAZIL	1	1245									1	1245
BULGARIA	2	1906									2	1906
CHINA	26	26620									26	26620
FINLAND	1	1600									1	1600
FRANCE	1	1600									1	1600
INDIA	2	1834			4	2520			1	470	7	4824
JAPAN			2	2650							2	2650
KOREA, REP. OF	5	5560									5	5560
PAKISTAN	2	630									2	630
RUSSIA	8	6484					1	915	1	789	10	8188
SLOVAKIA	2	782									2	782
UKRAINE	2	1900									2	1900
USA	1	1165									1	1165
TOTAL	53	51326	4	5250	5	3212	1	915	2	1259	65	61962

Note: The totals include 2 units (2x BWR), 2600 MW in Taiwan, China.
 During 2011, construction started on 4 reactors, 1890 MW.

TABLE 4. REACTOR YEARS OF EXPERIENCE, UP TO 31 DEC. 2011

Country	Reactors connected to the grid		Reactors in long term shutdown		Permanently shutdown reactors		Total, Operating and Shutdown			
	No.	Capacity MW(e) Net	No.	Net capacity MW(e)	No.	Net capacity MW(e)	No.	Net capacity MW(e)	Experience Years	Months
ARGENTINA	2	935					2	935	66	7
ARMENIA	1	375			1	376	2	751	37	8
BELGIUM	7	5927			1	10	8	5937	247	7
BRAZIL	2	1884			4	1632	2	1884	41	3
BULGARIA	2	1906			4	478	6	3538	151	3
CANADA	18	12604	4	2726	3	478	25	15808	618	2
CHINA	16	11816					16	11816	125	6
CZECH REP.	6	3766					6	3766	122	10
FINLAND	4	2736					4	2736	131	4
FRANCE	58	63130			12	3789	70	66919	1816	4
GERMANY	9	12068			27	14301	36	26369	782	9
HUNGARY	4	1889					4	1889	106	2
INDIA	20	4391					20	4391	357	3
IRAN, ISL. REP.	1	915					1	915		4
ITALY					4	1423	4	1423	81	
JAPAN	50	44215	1	246	9	4337	60	48798	1546	4
KAZAKHSTAN					1	52	1	52	25	10
KOREA, REP. OF	21	18751					21	18751	381	1
LITHUANIA					2	2370	2	2370	43	6
MEXICO	2	1300					2	1300	39	11
NETHERLANDS	1	482			1	55	2	537	67	8
PAKISTAN	3	725					3	725	52	
ROMANIA	2	1300					2	1300	19	11
RUSSIA	33	23643			5	786	38	24429	1058	4
SLOVAKIA	4	1816			3	909	7	2725	140	7
SLOVENIA	1	688					1	688	30	3
SOUTH AFRICA	2	1830					2	1830	54	3
SPAIN	8	7567			2	621	10	8188	285	6

TABLE 4. REACTOR YEARS OF EXPERIENCE, UP TO 31 DEC. 2011 — continued

Country	Reactors connected to the grid		Reactors in long term shutdown		Permanently shutdown reactors		Total, operating and shutdown			
	No.	Net capacity MW(e)	No.	Net capacity MW(e)	No.	Net capacity MW(e)	No.	Net capacity MW(e)	Experience Years	Experience Months
SWEDEN	10	9326			3	1210	13	10536	392	6
SWITZERLAND	5	3263			1	6	6	3269	184	11
UK	18	9953			27	3518	45	13471	1495	2
UKRAINE	15	13107			4	3515	19	16622	398	6
USA	104	101465			28	9764	132	111229	3707	11
Total	435	388791	5	2972	138	49152	578	420915	14792	3

Notes:

1. The total includes the following data from Taiwan, China:

— reactors connected to the grid: 6 units, 5018 MW; experience: 182 years, 1 month.

2. Operating experience is counted from the grid connection excluding any long term shutdown period.

TABLE 5. OPERATING REACTORS AND NET ELECTRICAL POWER, 1980 TO 2011

Country	Number of units and net capacity (MW(e)) connected to the grid at 31 Dec. of given year															
	1980		1985		1990		1995		2000		2005		2010		2011	
	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)
ARGENTINA	1	335	2	935	2	935	2	978	2	935	2	935	2	935	2	935
ARMENIA	2	816	2	816	1	376	1	376	1	376	1	376	1	375	1	375
BELGIUM	4	1670	8	5464	7	5501	7	5712	7	5801	7	5826	7	5927	7	5927
BRAZIL	3	1224	4	1632	1	626	2	1976	2	1884	2	1906	2	1884	2	1884
BULGARIA	10	5172	16	9741	20	13993	21	14902	14	9988	18	12584	18	12604	18	12604
CANADA	10	5172	16	9741	20	13993	21	14902	14	9988	18	12584	18	12604	18	12604
CHINA							3	2188	3	2188	9	6567	13	10065	16	11816
CZECH REP.			1	391	4	1632	4	1782	5	2611	6	3373	6	3678	6	3766
FINLAND	4	2208	4	2300	4	2310	4	2656	4	2676	4	2716	4	2716	4	2736
FRANCE	22	14388	43	37478	56	55808	56	58573	59	63080	59	63260	58	63130	58	63130
GERMANY	19	10323	24	18110	21	21250	19	20972	19	21283	17	20339	17	20490	9	12068
HUNGARY	2	825	2	825	4	1710	4	1729	4	1729	4	1755	4	1889	4	1889
INDIA	4	832	6	1143	7	1324	10	1746	14	2508	15	2993	19	4189	20	4391
IRAN, ISL. REP.															1	915
ITALY	4	1112	3	1273	41	30867	50	39625	52	43245	55	47593	54	46821	50	44215
JAPAN	23	14918	33	23612	41	30867	50	39625	52	43245	55	47593	54	46821	50	44215
KAZAKHSTAN	1	135	1	135	1	135	1	50	16	12990	20	1185	21	18698	21	18751
KOREA, REP. OF	1	564	5	3692	9	7220	11	9115	16	12990	20	1185	21	18698	21	18751
LITHUANIA	1	564	5	3692	9	7220	11	9115	16	12990	20	1185	21	18698	21	18751
MEXICO	2	488	2	508	1	640	2	1256	2	1290	2	1360	2	1300	2	1300
NETHERLANDS	1	125	1	137	1	125	2	510	1	449	1	450	1	482	1	482
PAKISTAN	1	125	1	137	1	125	1	125	2	425	2	425	2	425	3	725
ROMANIA									1	655	1	655	2	1300	2	1300
RUSSIA	20	8506	28	15841	29	18898	30	19848	30	19848	31	21743	32	22893	33	23643
SLOVAKIA	2	780	4	1632	4	1632	4	1632	6	2440	6	2442	4	1816	4	1816
SLOVENIA			1	632	1	620	1	676	1	656	1	666	1	688	1	688
SOUTH AFRICA	3	1073	8	5608	9	7099	9	7097	9	7468	9	7591	8	7514	8	7567
SPAIN	8	5510	12	9455	12	9826	12	10043	11	9412	10	8905	10	9303	10	9326
SWEDEN	8	5510	12	9455	12	9826	12	10043	11	9412	10	8905	10	9303	10	9326

TABLE 5. OPERATING REACTORS AND NET ELECTRICAL POWER, 1980 TO 2011 — continued

Country	Number of units and net capacity (MW(e)) connected to the grid at 31 Dec. of given year															
	1980		1985		1990		1995		2000		2005		2010		2011	
	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)	No.	MW(e)
SWITZERLAND	4	1940	5	2881	5	2942	5	3056	5	3170	5	3220	5	3238	5	3263
UK	33	6423	38	10077	37	11360	35	12910	33	12490	23	11852	19	10137	18	9953
UKRAINE	3	2306	10	8324	15	13020	15	13045	13	11195	15	13107	15	13107	15	13107
USA	69	50881	90	74401	108	96228	108	98068	103	96297	103	98145	104	101211	104	101465
WORLD	245	133037	363	245779	416	318253	434	341402	435	349999	441	368125	441	375280	435	368791

Note: The world total includes the following data in Taiwan, China:

– 1980: 2 units, 1208 MW; 1985: 6 units, 4890 MW; 1990: 6 units, 4828 MW; 1995: 6 units, 4884 MW; 2000: 6 units, 4884 MW; 2005: 6 units, 4982 MW; 2010: 6 units, 4982 MW; 2011: 6 units, 5018 MW.

TABLE 6. NUCLEAR ELECTRICITY PRODUCTION AND SHARE, 1980 TO 2011

Country	Nuclear capacity (TW(e)-h) of reactors connected to the grid at 31 Dec. of given year															
	1980		1985		1990		1995		2000		2005		2010		2011	
	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total
ARGENTINA	2.18	NA	5.25	11.7	6.72	19.8	6.57	11.8	5.74	7.3	6.37	6.9	6.69	5.9	5.89	5.0
ARMENIA	11.86	NA	29.25	59.8	40.59	60.1	39.30	55.5	1.84	33.0	2.50	42.7	2.29	39.4	2.36	33.2
BELGIUM			3.17	1.7	2.06	1.0	2.33	1.0	45.81	56.8	45.34	55.6	47.3	51.2	45.94	54.0
BRAZIL	5.71	NA	12.17	31.6	13.51	35.7	16.22	46.4	5.59	1.9	9.20	2.5	13.77	3.1	14.79	3.2
BULGARIA	38.02	NA	59.47	12.7	69.87	14.8	93.98	17.3	16.79	45.0	17.38	44.1	14.24	33.1	15.26	32.6
CANADA									69.12	11.8	86.83	14.5	85.50	15.1	88.32	15.3
CHINA									12.13	1.2	16.02	2.0	70.96	1.8	82.57	1.9
CZECH REP.			1.99	NA	11.77	NA	12.23	20.0	12.71	18.7	23.25	30.5	26.44	33.3	26.70	33.0
FINLAND	6.68	NA	17.98	38.2	18.13	35.1	18.13	29.9	21.58	32.2	22.36	32.9	21.89	28.4	22.27	31.6
FRANCE	57.31	NA	213.28	64.8	297.61	74.5	358.71	76.1	395.39	76.4	431.18	78.5	410.09	74.1	423.51	77.7
GERMANY	41.44	NA	119.59	31.2	139.37	33.1	146.13	29.6	160.66	30.6	154.61	26.6	133.01	22.6	102.31	17.8
HUNGARY			6.10	23.6	12.89	51.4	13.20	42.3	13.95	40.6	13.02	37.2	14.66	42.1	14.71	43.3
INDIA	2.77	NA	3.87	2.2	5.29	2.2	6.99	1.9	14.23	3.1	15.73	2.8	20.48	2.9	28.95	3.7
IRAN, ISL. REP.															0.10	0.0
ITALY	2.11	NA	6.46	3.8	145.37	187.19	275.51	33.4	306.24	33.8	280.50	29.3	280.25	29.2	156.18	18.1
JAPAN	79.11	NA		22.7		27.1	0.08	0.1								
KAZAKHSTAN																
KOREA, REP. OF	3.26	NA	12.36	23.2	50.26	49.1	60.21	36.1	103.54	40.7	137.59	44.7	141.89	32.2	147.76	34.6
LITHUANIA			8.75	NA	15.70	NA	10.64	86.1	7.42	73.9	9.54	70.3				
MEXICO					2.78	2.6	7.53	6.0	7.92	3.9	10.32	5.0	5.59	3.6	9.31	3.6
NETHERLANDS	3.97	NA	3.69	6.1	3.29	4.9	3.78	4.9	3.70	4.3	3.77	3.9	3.75	3.4	3.92	3.6
PAKISTAN	0.07	0.5	0.26	1.0	0.38	1.1	0.46	0.9	0.90	1.7	2.41	2.8	2.56	2.6	3.84	3.8
ROMANIA																
RUSSIA	43.78	NA	88.26	NA	109.62	NA	91.59	11.8	5.05	10.9	5.11	8.6	10.70	19.5	10.81	19.0
SLOVAKIA	4.52	NA	8.70	NA	11.16	NA	11.35	44.1	15.17	53.4	16.34	56.1	13.54	51.8	14.34	54.0
SLOVENIA			3.85	NA	4.39	NA	4.57	39.5	4.55	37.4	5.61	42.4	5.38	37.3	5.90	41.7
SOUTH AFRICA			5.39	4.2	8.47	5.6	11.29	6.5	13.00	6.6	12.24	5.5	12.90	5.2	12.94	5.2
SPAIN	4.98	NA	26.83	24.0	51.98	35.9	53.49	34.1	59.49	27.6	54.99	19.6	59.26	20.1	55.12	19.5
SWEDEN	25.42	NA	55.89	42.3	65.27	45.9	67.17	46.6	51.88	39.0	69.58	44.9	55.73	38.1	58.10	39.6

TABLE 6. NUCLEAR ELECTRICITY PRODUCTION AND SHARE, 1980 TO 2011 — continued

Country	Nuclear capacity (TW(e)-h) of reactors connected to the grid at 31 Dec. of given year															
	1980		1985		1990		1995		2000		2005		2010		2011	
	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total	TW(e)-h	% of total
SWITZERLAND	13.63	NA	21.28	39.8	22.40	42.6	23.68	39.9	25.05	38.2	22.11	38.0	25.34	38.0	25.69	40.9
UK	32.32	NA	53.73	19.6	58.77	19.7	70.64	25.4	72.99	21.9	75.34	20.0	56.85	15.5	62.66	17.8
UKRAINE	6.38	NA	35.81	NA	71.26	NA	65.78	37.8	72.56	47.3	83.40	48.5	83.95	48.1	84.89	47.2
USA	249.84	NA	378.68	15.5	578.08	20.6	673.52	22.5	755.55	19.8	783.35	19.3	807.08	19.6	790.44	19.3
WORLD	635.36		1327.43		1890.35		2190.91		2440.94		2626.34		2629.82		2517.97	

Note: The world total includes the following data from Taiwan, China:

1990: 31.54 TW(e)-h of nuclear electricity generation, representing 38.32% of the total electricity generated there;

1995: 33.8 TW(e)-h of nuclear electricity generation, representing 28.79% of the total electricity generated there;

2000: 37 TW(e)-h of nuclear electricity generation, representing 21.19% of the total electricity generated there;

2005: 38.4 TW(e)-h of nuclear electricity generation, representing 17.93% of the total electricity generated there;

2010: 39.89 TW(e)-h of nuclear electricity generation, representing 19.3% of the total electricity generated there;

2011: 40.37 TW(e)-h of nuclear electricity generation, representing 19.02% of the total electricity generated there.

TABLE 7. ANNUAL CONSTRUCTION STARTS AND CONNECTIONS TO THE GRID, 1954 TO 2011

Year	Construction starts		Connections to the grid		Reactors in operation	
	Number of units	Design capacity (MW(e))	Number of units	Design capacity (MW(e))	Number of units	Updated capacity (MW(e))
1954	1	60	1	5	1	5
1955	8	260			1	5
1956	5	577	1	35	2	65
1957	13	1836	3	119	5	209
1958	6	476	1	35	6	269
1959	7	976	5	176	11	548
1960	11	1010	4	438	15	1087
1961	7	1531	1	15	16	1104
1962	8	1379	9	955	25	2223
1963	5	1722	9	500	33	2677
1964	9	2866	8	1022	40	3686
1965	9	3291	8	1879	48	5910
1966	15	7052	8	1530	55	7539
1967	25	16287	11	2165	64	9595
1968	37	26859	7	1020	69	10648
1969	13	9277	10	3670	78	14121
1970	37	25526	6	3410	84	17656
1971	18	12660	16	7711	99	24320
1972	29	22335	16	8880	113	32797
1973	29	23492	20	12727	132	43761
1974	38	35222	26	17149	154	61021
1975	38	36449	15	10236	169	70414
1976	42	40656	19	14269	186	83992
1977	24	22691	18	13243	200	96385
1978	23	21735	20	15782	219	111923
1979	28	23909	8	6909	225	117814
1980	20	19134	21	15088	245	133037
1981	16	15149	23	20389	267	153832
1982	19	19765	19	15317	284	168317
1983	16	12218	23	19253	306	187756
1984	10	9528	33	31001	336	218452
1985	20	16286	33	31042	363	245779
1986	8	7201	27	27212	389	272074
1987	13	11019	22	22191	407	295812
1988	7	7722	14	13621	416	305212
1989	6	4018	12	10457	420	311942
1990	5	3366	10	10543	416	318253
1991	2	2246	4	3668	415	321924
1992	3	3105	6	4809	418	325261
1993	4	3715	9	9012	427	333914
1994	2	1330	5	4176	429	336934
1995			5	3635	434	341402
1996	1	610	6	7080	438	347296
1997	5	4386	3	3568	434	347895
1998	3	2096	4	3152	430	344915
1999	4	4583	4	2704	432	347368
2000	7	5399	6	3063	435	349999
2001	1	1304	3	2696	438	352730
2002	6	3440	6	4998	439	357296
2003	1	202	2	1700	437	359842
2004	2	1336	5	4785	438	364688
2005	3	2900	4	3923	441	368125
2006	4	3400	2	1435	435	369581
2007	8	6519	3	1785	439	371645
2008	10	10499			438	371495
2009	12	13165	2	1068	437	370705
2010	16	15846	5	3763	441	375280
2011	4	1890	7	3997	435	368791

TABLE 8. NUMBER OF NEW REACTORS CONNECTED TO THE GRID AND MEDIAN CONSTRUCTION TIME IN MONTHS

Country	1976 to 1980	1981 to 1985	1986 to 1990	1991 to 1995	1996 to 2000	2001 to 2005	2006 to 2010	2011
	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months
ARGENTINA		1						
ARMENIA	2	109						
BELGIUM	73	4						
BRAZIL		132			1			
BULGARIA	1	104	1	113				
CANADA	4	98	5	97				
CHINA		7	101	3		6	4	60
CZECH REP.		1	93	73	1	1	191	
FINLAND	4	74	3					
FRANCE	13	68	15	93	4			
GERMANY	9	100	6					
HUNGARY		2	2					
HUNGARY		112	90					
INDIA	1	154	1	120	4	1	4	105
INDIA		2	152	3				
IRAN, ISL. REP.								
ITALY	1	101						
JAPAN	11	46	8	46	3	4	1	53
KOREA, REP. OF	1	65	4	2	5	4	1	51
KOREA, REP. OF	63	80	1	61	59	4	54	
LITHUANIA		1	116					
LITHUANIA		80	1					
MEXICO		1	151	1				
PAKISTAN				210	1			64
PAKISTAN					83			
ROMANIA					1		1	160
ROMANIA	6	73	4	109	169	2	1	323
RUSSIA	2	99						
SLOVAKIA	89	80			2			
SLOVAKIA		1			118			
SLOVENIA		2						
SOUTH AFRICA		102						
SOUTH AFRICA	3	74	2					
SPAIN		5	96					
SPAIN		4						
SWEDEN	85							

TABLE 8. NUMBER OF NEW REACTORS CONNECTED TO THE GRID AND MEDIAN CONSTRUCTION TIME IN MONTHS — continued

Country	1976 to 1980		1981 to 1985		1986 to 1990		1991 to 1995		1996 to 2000		2001 to 2005		2006 to 2010		2011	
	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months	No. Months
SWITZERLAND	1	63	1	125												
UK	4	106	6	186	4	98	1	80								
UKRAINE	3	89	7	64	6	57	1	113			2	227				
USA	18	100	25	126	22	146	1	221	1	278						
TOTAL	86	74	131	99	85	95	29	103	23	123	20	64	12	75	7	105

Note: Construction time is measured from the first pouring of concrete to the connection of the unit to the grid.

The totals include the following data from Taiwan, China:

— 1976 to 1980: 2 units, 64 months;

— 1981 to 1985: 4 units, 72 months.

TABLE 9. CONSTRUCTION STARTS DURING 2011

Country	Reactor		Type	Model	Capacity (MW)		NSSS supplier	Construction start	Grid connection	Commercial operation
	Code	Name			Thermal	Gross				
INDIA	IN -21	RAJASTHAN-7	PHWR	Horizontal Pre	2177	700	NPCIL	2011-7	2016-3	2016-6
	IN -22	RAJASTHAN-8	PHWR	Horizontal Pre	2177	700	NPCIL	2011-9	2016-9	2016-12
PAKISTAN	PK -5	CHASNUPP 4	PWR	CNP-300	999	340	PAEC	2011-12	2017-7	2017-10
	PK -4	CHASNUPP 3	PWR	CNP-300	999	340	PAEC	2011-5	2016-9	2016-12

Note: During 2011, construction was started on 4 reactors (1890 MW).

TABLE 10. CONNECTIONS TO THE GRID DURING 2011

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	First criticality	Grid connection
	Code	Name			Thermal	Gross	Net					
CHINA	CN-84	CEFR	FBR	BN-20	65	25	20	CIAE	IZ	2000-5	2010-7	—
	CN-13	LINGAO 4	PWR	CPR-1000	2905	1080	1000	LDNPC	DFEC	2006-6	2011-2	2011-5
	CN-15	QINSHAN 2-4	PWR	CNP 600	1930	650	610	NFQJVC	CNNC	2007-1	2011-11	2011-11
INDIA	IN-16	KAIGA-4	PHWR	Horizontal Pre	800	220	202	NPCIL	NPCIL	2002-5	2010-11	2011-1
IRAN, ISL. REP.	IR-1	BUSHEHR 1	PWR	VVER V-446	3000	1000	915	NPPDCO	ASE	1975-5	2011-5	2011-9
PAKISTAN	PK-3	CHASNUPP 2	PWR	PWR	999	325	300	PAEC	CNNC	2005-12	2011-2	2011-3
RUSSIA	RU-37	KALININ-4	PWR	VVER V-320	3200	1000	950	REA	ROSATOM	1986-8	2011-11	—

Note: During 2011, 7 reactors (3997 MW) were newly connected to the grid.

TABLE 11. SCHEDULED CONNECTIONS TO THE GRID DURING 2012

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	First criticality	Grid connection
	Code	Name			Thermal	Gross	Net					
ARGENTINA	AR-3	ATUCHA-2	PHWR	PHWR KWU	2160	745	692	NASA	SIEMENS	1981-7	—	2012-7
INDIA	IN-26	KUDANKULAM-2	PWR	VVER V-412	3000	1000	917	NPCIL	MAEP	2002-7	2012-6	2012-7
KOREA, REP. OF	KR-22	SHIN-KORI-2	PWR	OPR-1000	2825	1000	960	KHNP	DHICKOPC	2007-6	2011-12	2012-1
	KR-23	SHIN-WOLSONG-1	PWR	OPR-1000	2825	1000	960	KHNP	DHICKOPC	2007-11	2012-1	2012-1
SLOVAKIA	SK-10	MOCHOVCE-3	PWR	VVER V-213	1375	440	391	EMO	SKODA	1987-1	2012-12	2012-12
USA	US-391	WATTS BAR-2	PWR	W (4-loop)	3425	1218	1165	TVA	WH	1972-12	—	2012-8

Note: During 2012, 6 reactors (5085 MW) are expected to achieve connection to grid.

TABLE 12. REACTORS PLANNED FOR CONSTRUCTION AS KNOWN ON 31 DEC. 2011

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Expected construction start
	Code	Name			Thermal	Gross	Net			
CHINA	CN -42	BAMAOSHAN	PWR	CPR-1000	2905	1080	900			
	CN -53	CHANGJIANG 3	PWR		1930	650	610			
	CN -54	CHANGJIANG 4	PWR		1930	650	610			
	CN -57	FANGCHENGANG 3	PWR				1000			
	CN -58	FANGCHENGANG 4	PWR				1000			
	CN -59	FANGCHENGANG 5	PWR				1000			
	CN -60	FANGCHENGANG 6	PWR				1000			
	CN -48	FUQING 4	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	
	CN -49	FUQING 5	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	
	CN -50	FUQING 6	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	
	CN -76	HAIYANG 3	PWR	AP-1000	3750	1250	1000	SNPC	WH	
	CN -77	HAIYANG 4	PWR	AP-1000	3750	1250	1000	SNPC	WH	
	CN -26	HONGSHIDING 1	PWR				0			
	CN -27	HONGSHIDING 2	PWR				0	HONGYANH	DFEC	
	CN -80	HONGYANHE 5	PWR	CPR-1000	CPR-1000	2905	1080	1000	LHNPC	DFEC
	CN -81	HONGYANHE 6	PWR	CPR-1000	CPR-1000	2905	1080	1000	LHNPC	DFEC
	CN -65	JIYANG 1	PWR				1000			
	CN -66	JIYANG 2	PWR				1000			
	CN -67	JIYANG 3	PWR				1000			
	CN -68	JIYANG 4	PWR				1000			
	CN -61	PENGZE 1	PWR				1250			
	CN -62	PENGZE 2	PWR				1250			
	CN -63	PENGZE 3	PWR				1250			
	CN -64	PENGZE 4	PWR				1250			
	CN -78	SANMEN 3	PWR	AP-1000	AP-1000	3750	1250	1000	SMNPCI	WH/MI
	CN -79	SANMEN 4	PWR	AP-1000	AP-1000	3750	1250	1000	SMNPCI	WH/MI
	CN -70	SANMING-1	FBR	BN-800	BN-800	2100	860	800	FSNPC	
	CN -71	SANMING-2	FBR	BN-800	BN-800	2100	860	800	FSNPC	
	CN -69	SHIDAOWAN 1	HTGR	HTGR-PM	HTGR-PM	500	200	200	HSNPC	

TABLE 12. REACTORS PLANNED FOR CONSTRUCTION AS KNOWN ON 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Expected construction start
	Code	Name			Thermal	Gross	Net			
	CN-32	TAOHUJIANG 1	PWR				0			
	CN-33	TAOHUJIANG 2	PWR	VVER V-428	3000	1000	933	JNPC	IZ	
	CN-72	TIANWAN 3	PWR	VVER V-428	3000	1000	933	JNPC	IZ	
	CN-73	TIANWAN 4	PWR	CNP-1000	2905	1080	1000	JNPC	DFEC	
	CN-74	TIANWAN 5	PWR	CNP-1000	2905	1080	1000	JNPC	DFEC	
	CN-75	TIANWAN 6	PWR				0			
	CN-40	XIANNING 1	PWR				0			
	CN-41	XIANNING 2	PWR				0			
	CN-82	XUDABU 1	PWR	CPR-1000	2905	1080	1000	LNPC	DFEC	
	CN-83	XUDABU 2	PWR	CPR-1000	2905	1080	1000	LNPC	DFEC	
	CN-44	YANGJIANG 4	PWR	CPR-1000	2905	1087	1000	YJNPC	DFEC	
	CN-45	YANGJIANG 5	PWR	CPR-1000	2905	1087	1000	YJNPC	DFEC	
	CN-46	YANGJIANG 6	PWR	CPR-1000	2905	1087	1000	YJNPC	DFEC	
	IRAN, ISL. REP.	IR-2	BUSHEHR 2	PWR	VVER V-446	3000	1000	915	NPPDCO	TBD
IR-5		BUSHEHR 3	PWR		3000	1000	915	NPPDCO	ASE	2013-7
IR-9		DARKHOVAIN	PWR	IR-360	1113	360	330	NPPDCO		2015-6
JAPAN	JP-76	HAMAOKA-6	BWR	ABWR	3926	1400	1350	CHUBU		
	JP-69	HIGASHI DORI 1 (TEPCO)	BWR	ABWR	3926	1385	1343	TEPCO		
	JP-74	HIGASHI DORI 2 (TEPCO)	BWR	ABWR	3926	1385	1343	TEPCO		
	JP-72	HIGASHI DORI 2 (TOHOKU)	BWR	ABWR	3926	1067	1067	TOHOKU		
	JP-62	KAMINOSEKI 1	BWR	ABWR	3926	1373	1325	CHUGOKU		
	JP-63	KAMINOSEKI 2	BWR	ABWR	3926	1373	1325	CHUGOKU		
	JP-73	NAMIE-ODAKA	BWR	BWR	4466	1590	825	TOHOKU		
	JP-75	SENDAL-3	PWR	APWR	4466	1590	1538	KYUSHU	MHI	
	JP-67	TSURUGA-3	PWR	APWR	4466	1590	1538	JAPCO	MHI	
	JP-68	TSURUGA-4	PWR	APWR	4466	1590	1538	JAPCO	MHI	
KOREA, REP. OF	KR-27	SHIN-ULCHIN-1	PWR	APR-1400	3938	1400	1340	KHNP	DHICKOPC	

TABLE 12. REACTORS PLANNED FOR CONSTRUCTION AS KNOWN ON 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Expected construction start
	Code	Name			Thermal	Gross	Net			
RUSSIA	KR-28	SHIN-JULCHIN-2	PWR	APR-1400	3983	1400	1340	KHNP	DHICKOPC	—
	RU -170	BALTIISK-1	PWR	VVER V-491	3200	1194	1109	REA	ROSATOM	2012-2
	RU -171	BALTIISK-2	PWR	VVER V-491	3200	1194	1109	REA	ROSATOM	—
	RU -202	BASHKIR-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -203	BASHKIR-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -177	CENTRAL-1	PWR	-	3200	1200	1115	REA	ROSATOM	—
	RU -178	CENTRAL-2	PWR	-	3200	1200	1115	REA	ROSATOM	—
	RU -185	CENTRAL-3	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -186	CENTRAL-4	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -175	KOLA 2-1	PWR	-	3200	1200	1115	REA	ROSATOM	—
	RU -176	KOLA 2-2	PWR	-	3200	1200	1115	REA	ROSATOM	—
	RU -166	KURSK 2-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -189	KURSK 2-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -190	KURSK 2-3	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -191	KURSK 2-4	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -165	LENINGRAD 2-3	PWR	VVER V-491	3200	1170	1085	REA	ROSATOM	—
	RU -167	LENINGRAD 2-4	PWR	VVER V-491	3200	1170	1085	REA	ROSATOM	—
	RU -181	NIZHEGORODSK-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -182	NIZHEGORODSK-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -179	PEVEK-1	PWR	KLT-40S	150	35	32	REA	ROSATOM	—
	RU -180	PEVEK-2	PWR	KLT-40S	150	35	32	REA	ROSATOM	—
	RU -196	PRIMORSK-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -197	PRIMORSK-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -187	SEVERSK-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -188	SEVERSK-2	PWR		3200	1200	1115	REA	ROSATOM	—
RU -198	SMOLENSK 2-1	PWR		3200	1200	1115	REA	ROSATOM	—	
RU -199	SMOLENSK 2-2	PWR		3200	1200	1115	REA	ROSATOM	—	
RU -204	SOUTH URALS 1	PWR		3000	1200	1115	REA	ROSATOM	—	
RU -205	SOUTH URALS 2	PWR		3000	1200	1115	REA	ROSATOM	—	

TABLE 12. REACTORS PLANNED FOR CONSTRUCTION AS KNOWN ON 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Expected construction start
	Code	Name			Thermal	Gross	Net			
USA	RU -206	SOUTH URALS 3	PWR		3000	1200	1115	REA	ROSATOM	—
	RU -200	TATAR-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -201	TATAR-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -192	TVERSK-1	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -193	TVERSK-2	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -194	TVERSK-3	PWR		3200	1200	1115	REA	ROSATOM	—
	RU -195	TVERSK-4	PWR		3200	1200	1115	REA	ROSATOM	—
	US -5039	BELL BEND	PWR	EPR	4300	1720	1600		AREVA	—
	US -5016	CALVERT CLIFFS-3	PWR	US-EPR	4300	1720	1600			—
	US -5034	COMANCHE PEAK-3	PWR	US-APWR			1700			—
	US -5035	COMANCHE PEAK-4	PWR	US-APWR			1700			—
	US -5033	ENRICO FERMI-3	BWR	ESBWR	4500	1600	1520			—
	US -5029	LEVY COUNTY-1	PWR	AP-1000	3750	1250	1117	PROGRESS	WH	—
	US -5030	LEVY COUNTY-2	PWR	AP-1000	3750	1250	1117		WH	—
	US -5017	NORTH ANNA-3	PWR	US-APWR			1500			—
	US -5022	SHEARON HARRIS-2	PWR	AP-1000	3750	1250	1117			—
	US -5023	SHEARON HARRIS-3	PWR	AP-1000	3750	1250	1117			—
	US -5012	SOUTH TEXAS-3	BWR	ABWR	3926	1400	1350			—
	US -5013	SOUTH TEXAS-4	BWR	ABWR	3926	1400	1350			—
US -5040	TURKEY POINT-6	PWR	AP-1000	3750	1250	1117			—	
US -5041	TURKEY POINT-7	PWR	AP-1000	3750	1250	1117			—	
US -5027	VIRGIL C. SUMMER-2	PWR	AP-1000	3750	1250	1117			—	
US -5028	VIRGIL C. SUMMER-3	PWR	AP-1000	3750	1250	1117			—	
US -5025	VOGTLE-3	PWR	AP-1000	3750	1250	1117			—	
US -5026	VOGTLE-4	PWR	AP-1000	3750	1250	1117			—	
US -5018	WILLIAM STATES LEE III -1	PWR	AP-1000	3750	1250	1117			—	
US -5019	WILLIAM STATES LEE III -2	PWR	AP-1000	3750	1250	1117			—	
VIETNAM	VN -1	PHUOC DINH 1	PWR			1000	EVN	ROSATOM	—	
	VN -2	PHUOC DINH 2	PWR			1000	EVN	ROSATOM	—	

Note: Status as of 31 December 2011, 114 reactors (117329 MW) were known as being planned.

TABLE 13. REACTORS UNDER CONSTRUCTION, 31 DEC. 2011

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	First criticality	Grid connection	Commercial operation
	Code	Name			Thermal	Gross	Net						
ARGENTINA	AR-3	ATUCHA-2	PWR	PHWR KWU	2160	745	692	NASA	SIEMENS	1981-7	—	2012-7	—
BULGARIA	BG-7	BELENE-1	PWR	VVER V-466	3000	1000	953	KOZNPP	ASE	1987-1	—	—	—
	BG-8	BELENE-2	PWR	VVER V-466	3000	1000	953	KOZNPP	ASE	1987-3	—	—	—
BRAZIL	BR-3	ANGRA-3	PWR	PRE KONVOI	3765	1350	1245	ELETRONU	KWU	2010-6	—	—	2016-1
CHINA	CN-51	CHANGJIANG 1	PWR	CNP-600	1930	650	610	HNPC	DFEC	2010-4	—	—	—
	CN-52	CHANGJIANG 2	PWR	CNP-600	1930	650	610	HNPC	DFEC	2010-11	—	—	2015-12
	CN-55	FANGCHENGANG 1	PWR	CPR-1000	2905	1087	1000	GFNPC	DFEC	2010-7	—	—	—
	CN-56	FANGCHENGANG 2	PWR	CPR-1000	2905	1087	1000	GFNPC	DFEC	2010-12	—	—	—
	CN-28	FANGJASHAN 1	PWR	CNP-1000	2905	1087	1000	QNPC	DFEC	2008-12	—	—	—
	CN-29	FANGJASHAN 2	PWR	CNP-1000	2905	1087	1000	QNPC	DFEC	2009-7	—	—	—
	CN-30	FUJING 1	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	2008-11	—	—	—
	CN-31	FUJING 2	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	2009-6	—	—	—
	CN-47	FUJING 3	PWR	CPR-1000	2905	1087	1000	FQNP	DFEC	2010-12	—	—	2015-7
	CN-24	HAIYANG 1	PWR	AP-1000	3750	1250	1000	SNPC	WH	2009-9	—	—	—
	CN-25	HAIYANG 2	PWR	AP-1000	3750	1250	1000	SNPC	WH	2010-6	—	—	—
	CN-20	HONGYANHE 1	PWR	CPR-1000	2905	1080	1000	LHNPC	DFEC	2007-8	—	—	—
	CN-21	HONGYANHE 2	PWR	CPR-1000	2905	1080	1000	LHNPC	DFEC	2008-3	—	—	—
	CN-22	HONGYANHE 3	PWR	CPR-1000	2905	1080	1000	LHNPC	DFEC	2009-3	—	—	—
	CN-23	HONGYANHE 4	PWR	CPR-1000	2905	1080	1000	LHNPC	DFEC	2009-8	—	—	—
	CN-36	NINGDE 1	PWR	CPR-1000	2905	1087	1000	NDNPC	DFEC	2008-2	—	—	—
CN-37	NINGDE 2	PWR	CPR-1000	2905	1080	1000	NDNPC	DFEC	2008-11	—	—	—	
CN-38	NINGDE 3	PWR	CPR-1000	2905	1080	1000	NDNPC	DFEC	2010-1	—	—	—	
CN-39	NINGDE 4	PWR	CPR-1000	2905	1080	1000	NDNPC	DFEC	2010-9	—	—	—	
CN-16	SANMEN 1	PWR	AP-1000	3750	1250	1000	SMNPC	WH/MHI	2009-4	—	—	—	
CN-17	SANMEN 2	PWR	AP-1000	3750	1250	1000	SMNPC	WH/MHI	2009-12	—	—	—	
CN-34	TAISHAN 1	PWR	EPR-1700	4500	1750	1700	TNPC	AREVA	2009-10	—	—	—	

TABLE 13. REACTORS UNDER CONSTRUCTION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	First criticality	Grid connection	Commercial operation	
	Code	Name			Thermal	Gross							Net
	CN-35	TAISHAN 2	PWR	EPR-1700	4500	1750	1700	AREVA	2010-4	—	—	—	
	CN-18	YANGJIANG 1	PWR	CPR-1000	2905	1087	1000	YJNPC	2008-12	—	—	—	
	CN-19	YANGJIANG 2	PWR	CPR-1000	2905	1087	1000	YJNPC	2009-6	—	—	—	
	CN-43	YANGJIANG 3	PWR	CPR-1000	2905	1087	1000	YJNPC	2010-11	—	—	—	
FINLAND	FI-5	OLKILUOTO-3	PWR	EPR	4300	1720	1600	TVO	2005-8	—	—	2013-8	
FRANCE	FR-74	FLAMANVILLE-3	PWR	EPR	4300	1650	1600	EDF	2007-12	2016-12	2016-12	—	
	IN-30	KAKRAPAR-3	PHWR	PHWR-700	2166	700	630	NPCIL	2010-11	2014-12	2015-3	2015-6	
INDIA	IN-31	KAKRAPAR-4	PHWR	PHWR-700	2166	700	630	NPCIL	2010-11	2015-6	2015-9	2015-12	
	IN-25	KUDANKULAM-1	PWR	VVER V-412	3000	1000	917	NPCIL	2002-3	—	—	—	
	IN-26	KUDANKULAM-2	PWR	VVER V-412	3000	1000	917	NPCIL	2002-7	2012-6	2012-7	2012-8	
	IN-29	PFBR	FBR	Horizontal Pre	1253	500	470	BHAVINI	2004-10	—	—	—	
	IN-21	RAJASTHAN-7	PHWR	Horizontal Pre	2177	700	630	NPCIL	2011-7	2015-12	2016-3	2016-6	
	IN-22	RAJASTHAN-8	PHWR	Horizontal Pre	2177	700	630	NPCIL	2011-9	2016-6	2016-9	2016-12	
	JAPAN	JP-66	OHMA	BWR	ABWR	3926	1383	1325	EPDC	2010-5	—	—	2014-11
		JP-65	SHIMANE-3	BWR	ABWR	3926	1373	1325	CHUGOKU HITACHI	2007-10	—	—	—
KOREA, REP. OF	KR-22	SHIN-KORI-2	PWR	OPR-1000	2825	1000	960	KHNP	2007-6	2011-12	2012-1	—	
	KR-25	SHIN-KORI-3	PWR	APR-1400	3983	1400	1340	KHNP	2008-10	—	—	2013-9	
	KR-26	SHIN-KORI-4	PWR	APR-1400	3938	1400	1340	KHNP	2009-8	—	—	2014-9	
	KR-23	SHIN-WOLSONG-1	PWR	OPR-1000	2825	1000	960	KHNP	2007-11	2012-1	2012-1	—	
	KR-24	SHIN-WOLSONG-2	PWR	OPR-1000	2825	1000	960	KHNP	2008-9	—	—	—	
PAKISTAN	PK-4	CHASNUPP 3	PWR	CNP-300	999	340	315	PAEC	2011-5	2016-8	2016-9	2016-12	
	PK-5	CHASNUPP 4	PWR	CNP-300	999	340	315	PAEC	2011-12	2017-6	2017-7	2017-10	
RUSSIA	RU-151	AKADEMIK LOMONOSOV 1	PWR	KL-T-40S Float	150	35	32	REA	2007-4	—	—	2013-12	

TABLE 13. REACTORS UNDER CONSTRUCTION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	First criticality	Grid connection	Commercial operation
	Code	Name			Thermal	Gross	Net						
	RU -152	AKADEMIK LOMONOSOV 2	PWR	KL T-40S Float	150	35	32	REA	ROSATOM	2007-4	—	—	2013-12
	RU -116	BELOYARSKY-4 (BN-800)	FBR	BN-800	2100	864	789	REA	ROSATOM	2006-7	—	—	—
	RU -120	KURSK-5	LWGR	RBMK-1000	3200	1000	915	REA	ROSATOM	1985-12	—	—	—
	RU -163	LENINGRAD 2-1	PWR	VVER V-491	3200	1170	1085	REA	ROSATOM	2008-10	—	—	—
	RU -164	LENINGRAD 2-2	PWR	VVER V-491	3200	1170	1085	REA	ROSATOM	2010-4	—	—	—
	RU -161	NOVOVORONEZH 2-1	PWR	VVER V-392M	3200	1200	1114	REA	ROSATOM	2008-6	—	—	2013-12
	RU -162	NOVOVORONEZH 2-2	PWR	VVER V-392M	3200	1200	1114	REA	ROSATOM	2009-7	—	—	—
	RU -63	ROSTOV-3	PWR	VVER V-320	3000	1070	1011	REA	ROSATOM	2009-9	—	—	—
	RU -64	ROSTOV-4	PWR	VVER V-320	3000	1070	1011	REA	ROSATOM	2010-6	—	—	—
SLOVAKIA	SK -10	MOCHOVCE-3	PWR	VVER V-213	1375	440	391	EMO	SKODA	1987-1	2012-12	2012-12	2013-2
	SK -11	MOCHOVCE-4	PWR	VVER V-213	1375	440	391	EMO	SKODA	1987-1	2013-8	2013-9	2013-10
UKRAINE	UA -51	KHMELNITSKI-3	PWR	VVER V-392B	3200	1000	950	NNEG	ASE	1986-3	—	2015-1	—
	UA -52	KHMELNITSKI-4	PWR	VVER V-392B	3200	1000	950	NNEG	ASE	1987-2	—	2016-1	—
USA	US -391	WATTS BAR-2	PWR	W (4-loop) IC	3425	1218	1165	TVA	WH	1972-12	—	2012-8	—

Note: Status as of 31 December 2011. 65 reactors (61962 MW) were under construction, including 2 units (2600 MW) in Taiwan, China:

TAIWAN, CN	TW -7	LUNG MEN 1	BWR	ABWR	3926	1350	1300	TPC	GE	1999-3	—	—	—
TAIWAN, CN	TW -8	LUNG MEN 2	BWR	ABWR	3926	1350	1300	TPC	GE	1999-8	—	—	—

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction Start	Grid connection	Commercial operation	EAF % 2007-2011	UCF % 2007-2011	Non-electrical applics
	Code	Name			Thermal	Gross								
ARGENTINA	AR-1	ATUCHA-1	PWR	PHWR KWU	1179	357	NASA	SIEMENS	1968-6	1974-3	1974-6	87.4	87.6	-
	AR-2	EMBALSE	PWR	CANDU 6	2015	648	NASA	AECL	1974-4	1983-4	1984-1	80.1	80.2	-
ARMENIA	AM-19	ARMENIA-2	PWR	WVER V-270	1375	408	ANPPJSC	FAEA	1975-7	1980-1	1980-5	71.2	72.3	-
BELGIUM	BE-2	DOEL-1	PWR	WE (2 loops)	1311	454	ELECTRAB	ACECOWEN	1969-7	1974-8	1975-2	84.9	84.9	-
	BE-4	DOEL-2	PWR	WE (2 loops)	1311	454	ELECTRAB	ACECOWEN	1971-9	1975-8	1975-12	90.7	90.7	-
	BE-5	DOEL-3	PWR	WE 3-loops	3054	1056	ELECTRAB	FRAMACEC	1975-1	1982-6	1982-10	86.8	87.1	-
	BE-7	DOEL-4	PWR	WE 3-loops	2988	1090	ELECTRAB	ACECOWEN	1978-12	1985-4	1985-7	86.4	86.4	-
	BE-3	TIHANGE-1	PWR	Framatome 3 ld	2873	1009	ELECTRAB	ACLF	1970-6	1975-3	1975-10	87.1	88.1	-
	BE-6	TIHANGE-2	PWR	WE 3-loops	3064	1055	ELECTRAB	FRAMACEC	1976-4	1982-10	1983-6	89.8	90.1	-
	BE-8	TIHANGE-3	PWR	WE 3-loops	3000	1094	ELECTRAB	ACECOWEN	1978-11	1985-6	1985-9	88.3	88.9	-
	BRAZIL	BR-1	ANGRA-1	PWR	2-loop WE	1882	640	ELETRONU WH	WH	1971-5	1982-4	1985-1	73.0	73.1
	BR-2	ANGRA-2	PWR	PRE KONVOI	3764	1350	ELETRONU KWU	KWU	1976-1	2000-7	2001-2	90.3	90.9	-
BULGARIA	BG-5	KOZLODUY-5	PWR	WVER V-320	3000	1000	KOZNP	AEE	1980-7	1987-11	1988-12	86.3	86.7	DH
	BG-6	KOZLODUY-6	PWR	WVER V-320	3000	1000	KOZNP	AEE	1982-4	1991-8	1993-12	86.1	86.7	DH
CANADA	CA-10	BRUCE-3	PWR	CANDU 750A	2832	805	BRUCEPOW	OHA/ECL	1972-7	1977-12	1978-2	76.6	77.2	-
	CA-11	BRUCE-4	PWR	CANDU 750A	2832	805	BRUCEPOW	OHA/ECL	1972-9	1978-12	1979-1	86.9	87.4	-
	CA-18	BRUCE-5	PWR	CANDU 750B	2832	872	BRUCEPOW	OHA/ECL	1978-6	1984-12	1985-3	90.7	91.0	-
	CA-19	BRUCE-6	PWR	CANDU 750B	2690	891	BRUCEPOW	OHA/ECL	1978-1	1984-6	1984-9	85.8	85.9	-
	CA-20	BRUCE-7	PWR	CANDU 750B	2832	872	BRUCEPOW	OHA/ECL	1979-5	1986-4	1986-4	89.9	90.0	-
	CA-21	BRUCE-8	PWR	CANDU 750B	2690	845	BRUCEPOW	OHA/ECL	1979-8	1987-3	1987-5	91.7	91.9	-
	CA-22	DARLINGTON-1	PWR	CANDU 850	2776	934	OPG	OHA/ECL	1982-4	1990-12	1992-11	88.5	89.6	-
	CA-23	DARLINGTON-2	PWR	CANDU 850	2776	934	OPG	OHA/ECL	1981-9	1990-12	1990-10	89.5	90.4	-
CANADA	CA-24	DARLINGTON-3	PWR	CANDU 850	2776	934	OPG	OHA/ECL	1984-9	1992-12	1993-2	92.5	93.4	-
	CA-25	DARLINGTON-4	PWR	CANDU 850	2776	934	OPG	OHA/ECL	1985-7	1993-4	1993-6	87.8	88.6	-

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DH district heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics		
	Code	Name			Thermal	Gross									Net	
CHINA	CA-12	GENTILLY-2	PHWR	CANDU 6	2156	675	635	HQ	AECL	1966-6	1982-12	1983-10	66.7	69.6	-	
	CA-4	PICKERING-1	PHWR	CANDU 500A	542	515	515	OPG	OHA/ECL	1971-4	1971-4	1971-7	65.2	65.4	-	
	CA-7	PICKERING-4	PHWR	CANDU 500A	1744	542	515	OPG	OHA/ECL	1968-5	1973-5	1973-6	56.9	57.1	-	
	CA-13	PICKERING-5	PHWR	CANDU 500B	1744	540	516	OPG	OHA/ECL	1974-11	1982-12	1983-5	68.6	69.3	-	
	CA-14	PICKERING-6	PHWR	CANDU 500B	1744	540	516	OPG	OHA/ECL	1975-10	1983-11	1984-2	80.2	80.5	-	
	CA-15	PICKERING-7	PHWR	CANDU 500B	1744	540	516	OPG	OHA/ECL	1976-3	1984-11	1985-1	74.2	74.5	-	
	CA-16	PICKERING-8	PHWR	CANDU 500B	1744	540	516	OPG	OHA/ECL	1976-9	1986-1	1986-2	79.7	80.5	-	
	CA-17	POINT LEPREAU	PHWR	CANDU 6	2180	680	635	NBEPCC	AECL	1975-5	1982-9	1983-2	22.0	22.0	-	
	CN-84	CEFR	FBR	BN-20	65	25	20	CIAE	IZ	2000-5	2011-7	—	—	—	—	-
	CN-2	GUANGDONG-1	PWR	M310	2905	984	944	GNP/JVC	FRAM	1987-8	1993-8	1994-2	94.2	94.2	-	
	CN-3	GUANGDONG-2	PWR	M310	2905	984	944	GNP/JVC	FRAM	1988-4	1994-2	1994-5	90.8	90.8	-	
	CN-6	LINGAO 1	PWR	M310	2905	990	938	LANPC	FRAM	1997-5	2002-2	2002-5	89.9	90.1	-	
	CN-7	LINGAO 2	PWR	M310	2905	990	938	LANPC	FRAM	1997-11	2002-12	2003-1	89.7	89.7	-	
	CN-12	LINGAO 3	PWR	CPR-1000	2905	1080	1007	LDNPC	DFEC	2005-12	2010-7	2010-9	73.2	73.2	-	
	CN-13	LINGAO 4	PWR	CPR-1000	2905	1080	1007	LDNPC	DFEC	2006-6	2011-5	2011-8	99.5	99.5	-	
	CN-1	QINSHAN 1	PWR	CNP-300	966	310	298	GNPC	CNNC	1985-3	1991-12	1994-4	87.2	87.3	-	
	CN-4	QINSHAN 2-1	PWR	CNP-600	1930	650	610	NPQJVC	CNNC	1996-6	2002-2	2002-4	79.5	79.5	-	
CN-5	QINSHAN 2-2	PWR	CNP-600	1930	650	610	NPQJVC	CNNC	1997-4	2004-3	2004-5	87.8	87.9	-		
CN-14	QINSHAN 2-3	PWR	CNP-600	1930	650	610	NPQJVC	CNNC	2006-3	2010-8	2010-10	83.1	83.1	-		
CN-15	QINSHAN 2-4	PWR	CNP 600	1930	650	610	NPQJVC	CNNC	2007-1	2011-11	2011-12	—	—	-		
CN-8	QINSHAN 3-1	PHWR	CANDU 6	2064	700	650	TQNPC	AECL	1998-6	2002-11	2002-12	90.3	90.4	-		
CN-9	QINSHAN 3-2	PHWR	CANDU 6	2064	700	650	TQNPC	AECL	1998-9	2003-6	2003-7	92.5	92.7	-		
CN-10	TIANWAN 1	PWR	VVER V-428	3000	1060	990	JNPC	IZ	1999-10	2006-5	2007-5	80.1	80.1	-		
CN-11	TIANWAN 2	PWR	VVER V-428	3000	1060	990	JNPC	IZ	2000-10	2007-5	2007-8	84.2	84.2	-		
CZECH REP.	CZ-4	DUKOVANY-1	PWR	VVER V-213	1375	488	471	CEZ	SKODA	1979-1	1985-2	1985-5	87.2	87.4	-	
	CZ-5	DUKOVANY-2	PWR	VVER V-213	1375	456	427	CEZ	SKODA	1979-1	1986-1	1986-3	88.8	89.3	-	
	CZ-8	DUKOVANY-3	PWR	VVER V-213	1444	498	471	CEZ	SKODA	1979-3	1986-11	1986-12	85.3	86.0	-	
	CZ-9	DUKOVANY-4	PWR	VVER V-213	1375	498	471	CEZ	SKODA	1979-3	1987-6	1987-7	85.2	85.8	-	

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics		
	Code	Name			Thermal	Gross									Net	
	CZ-23	TEMELIN-1	PWR	VVER V-320	3000	1013	963	CEZ	SKODA	1987-2	2000-12	2002-6	68.8	68.9	DH	
	CZ-24	TEMELIN-2	PWR	VVER V-320	3000	1013	963	CEZ	SKODA	1987-2	2002-12	2003-4	78.7	79.2	DH	
FINLAND	FI-1	LOVISA-1	PWR	VVER V-213	1500	510	488	FORTUMPH AEE	1971-5	1977-2	1977-5	1977-5	91.7	92.1	-	
	FI-2	LOVISA-2	PWR	VVER V-213	1500	510	488	FORTUMPH AEE	1972-8	1980-11	1981-1	1981-1	92.7	93.4	-	
	FI-3	OLKILUOTO-1	BWR	BWR-2500	2500	910	880	TVO	ASEASTAL	1974-2	1979-10	1979-10	94.6	95.1	-	
	FI-4	OLKILUOTO-2	BWR	BWR-2500	2500	910	880	TVO	ASEASTAL	1975-11	1980-2	1982-7	1982-7	93.7	94.4	-
		FR-54	BELLEVILLE-1	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1980-5	1987-10	1988-6	70.6	71.6	-
FRANCE	FR-55	BELLEVILLE-2	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1980-8	1988-7	1989-1	80.5	83.3	-	
	FR-32	BLAYAIS-1	PWR	CP1	2785	951	910	EDF	FRAM	1977-1	1981-6	1981-12	79.4	83.3	-	
	FR-33	BLAYAIS-2	PWR	CP1	2785	951	910	EDF	FRAM	1977-1	1982-7	1983-2	79.6	82.0	-	
	FR-34	BLAYAIS-3	PWR	CP1	2785	951	910	EDF	FRAM	1978-4	1983-8	1983-11	84.3	87.3	-	
	FR-35	BLAYAIS-4	PWR	CP1	2785	951	910	EDF	FRAM	1978-4	1983-5	1983-10	78.8	81.8	-	
	FR-13	BUGEY-2	PWR	CP0	2785	945	910	EDF	FRAM	1972-11	1978-5	1979-3	73.8	76.1	-	
	FR-14	BUGEY-3	PWR	CP0	2785	945	910	EDF	FRAM	1973-9	1978-9	1979-3	56.3	61.5	-	
	FR-15	BUGEY-4	PWR	CP0	2785	917	880	EDF	FRAM	1974-6	1979-3	1979-7	71.8	73.8	-	
	FR-16	BUGEY-5	PWR	CP0	2785	917	880	EDF	FRAM	1974-7	1979-7	1980-1	73.9	77.8	-	
	FR-50	CATTENOM-1	PWR	P4 REP 1300	3817	1362	1300	EDF	FRAM	1979-10	1986-11	1987-4	84.9	87.4	-	
	FR-53	CATTENOM-2	PWR	P4 REP 1300	3817	1362	1300	EDF	FRAM	1980-7	1987-9	1988-2	78.8	81.8	-	
	FR-60	CATTENOM-3	PWR	P4 REP 1300	3817	1362	1300	EDF	FRAM	1982-6	1990-7	1991-2	77.4	78.8	-	
	FR-65	CATTENOM-4	PWR	P4 REP 1300	3817	1362	1300	EDF	FRAM	1983-9	1991-5	1992-1	83.7	85.8	-	
	FR-40	CHINON-B-1	PWR	CP2	2785	954	905	EDF	FRAM	1977-3	1982-11	1984-2	65.2	70.9	-	
	FR-41	CHINON-B-2	PWR	CP2	2785	954	905	EDF	FRAM	1977-3	1983-11	1984-8	75.8	77.6	-	
	FR-56	CHINON-B-3	PWR	CP2	2785	954	905	EDF	FRAM	1980-10	1986-10	1987-3	72.7	75.2	-	
	FR-57	CHINON-B-4	PWR	CP2	2785	954	905	EDF	FRAM	1981-2	1987-11	1988-4	73.7	78.2	-	
	FR-62	CHOOZ-B-1	PWR	N4 REP 1450	4270	1560	1500	EDF	FRAM	1984-1	1996-8	2000-5	77.5	78.8	-	
	FR-70	CHOOZ-B-2	PWR	N4 REP 1450	4270	1560	1500	EDF	FRAM	1985-12	1997-4	2000-9	81.4	84.1	-	
	FR-72	CIVAUX-1	PWR	N4 REP 1450	4270	1561	1495	EDF	FRAM	1988-10	1997-12	2002-1	73.5	74.6	-	
FR-73	CIVAUX-2	PWR	N4 REP 1450	4270	1561	1495	EDF	FRAM	1991-4	1999-12	2002-4	84.4	87.2	-		

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DH district heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applies
	Code	Name			Thermal	Gross								
	FR-42	CRUAS-1	PWR	CP2	2785	956	915	EDF	FRAM	1978-8	1983-4	70.7	74.9	-
	FR-43	CRUAS-2	PWR	CP2	2785	956	915	EDF	FRAM	1978-11	1984-9	68.2	72.0	-
	FR-44	CRUAS-3	PWR	CP2	2785	956	915	EDF	FRAM	1979-4	1984-5	74.4	76.4	-
	FR-45	CRUAS-4	PWR	CP2	2785	956	915	EDF	FRAM	1979-10	1984-10	74.3	76.8	-
	FR-22	DAMPIERRE-1	PWR	CP1	2785	937	890	EDF	FRAM	1975-2	1980-3	78.3	81.4	-
	FR-29	DAMPIERRE-2	PWR	CP1	2785	937	890	EDF	FRAM	1975-4	1980-12	83.5	85.5	-
	FR-30	DAMPIERRE-3	PWR	CP1	2785	937	890	EDF	FRAM	1975-9	1981-1	80.4	82.3	-
	FR-31	DAMPIERRE-4	PWR	CP1	2785	937	890	EDF	FRAM	1975-12	1981-8	79.4	82.0	-
	FR-11	FESSENHEIM-1	PWR	CP0	2660	920	880	EDF	FRAM	1971-9	1978-1	66.8	67.8	-
	FR-12	FESSENHEIM-2	PWR	CP0	2660	920	880	EDF	FRAM	1972-2	1977-4	57.3	59.5	-
	FR-46	FLAMANVILLE-1	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1979-12	1985-12	71.5	73.5	-
	FR-47	FLAMANVILLE-2	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1980-5	1986-7	74.3	77.2	-
	FR-61	GOLFEGH-1	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1982-11	1991-2	88.5	90.1	-
	FR-68	GOLFEGH-2	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1984-10	1993-6	85.5	87.3	-
	FR-20	GRAVELINES-1	PWR	CP1	2785	951	910	EDF	FRAM	1975-2	1980-3	75.1	76.8	-
	FR-21	GRAVELINES-2	PWR	CP1	2785	951	910	EDF	FRAM	1975-3	1980-8	80.7	82.3	-
	FR-27	GRAVELINES-3	PWR	CP1	2785	951	910	EDF	FRAM	1975-12	1981-6	74.6	76.5	-
	FR-28	GRAVELINES-4	PWR	CP1	2785	951	910	EDF	FRAM	1976-4	1981-6	83.3	84.6	-
	FR-51	GRAVELINES-5	PWR	CP1	2785	951	910	EDF	FRAM	1979-10	1984-8	83.3	84.9	-
	FR-52	GRAVELINES-6	PWR	CP1	2785	951	910	EDF	FRAM	1979-10	1985-8	79.6	80.0	-
	FR-58	NOGENT-1	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1981-5	1988-2	83.1	86.5	-
	FR-59	NOGENT-2	PWR	P4 REP 1300	3817	1363	1310	EDF	FRAM	1982-1	1988-12	75.6	76.8	-
	FR-36	PALUEL-1	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1977-8	1985-12	79.8	84.9	-
	FR-37	PALUEL-2	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1978-1	1985-9	81.3	83.4	-
	FR-38	PALUEL-3	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1979-2	1985-9	62.5	64.6	-
	FR-39	PALUEL-4	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1980-2	1986-4	77.5	79.3	-
	FR-63	PENLY-1	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1982-9	1990-5	77.7	78.4	-
	FR-64	PENLY-2	PWR	P4 REP 1300	3817	1382	1330	EDF	FRAM	1984-8	1992-2	85.1	87.0	-
	FR-48	ST. ALBAN-1	PWR	P4 REP 1300	3817	1381	1335	EDF	FRAM	1979-1	1986-5	65.0	66.4	-
	FR-49	ST. ALBAN-2	PWR	P4 REP 1300	3817	1381	1335	EDF	FRAM	1979-7	1986-7	79.0	81.4	-

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007-2011	UCF % 2007-2011	Non-electrical applics	
	Code	Name			Thermal	Gross									Net
	FR-17	ST. LAURENT-B-1	PWR	CP2	2785	956	915	EDF	1976-5	1981-1	1983-8	81.3	85.1	-	
	FR-23	ST. LAURENT-B-2	PWR	CP2	2785	956	915	EDF	1976-5	1981-6	1983-8	77.6	80.7	-	
	FR-18	TRICASTIN-1	PWR	CP1	2785	955	915	EDF	1974-11	1980-5	1980-12	78.5	80.6	-	
	FR-19	TRICASTIN-2	PWR	CP1	2785	955	915	EDF	1974-12	1980-8	1980-12	74.9	77.0	-	
	FR-25	TRICASTIN-3	PWR	CP1	2785	955	915	EDF	1975-4	1981-2	1981-5	78.3	79.6	-	
	FR-26	TRICASTIN-4	PWR	CP1	2785	955	915	EDF	1975-5	1981-6	1981-11	83.2	84.9	-	
	GERMANY	DE-32	BROKDORF (KBR)	PWR	PWR	3900	1480	1410	E.ON	1976-1	1986-10	1986-12	91.0	91.2	-
		DE-33	EMSLAND (KKE)	PWR	Konvoi	3850	1400	1329	KLE	1982-8	1988-4	1988-6	94.1	94.2	-
DE-23		GRAFENHEINFELD (KKG)	PWR	PWR	3765	1345	1275	E.ON	1975-1	1981-12	1982-6	84.2	84.3	-	
DE-27		GROHDE (KWG)	PWR	PWR	3900	1430	1360	KWG	1976-6	1984-9	1985-2	90.1	91.4	-	
DE-26		GUNDEMMINGEN-B (GUN-B)	BWR	BWR-72	3840	1344	1284	KGK	1976-7	1984-3	1984-7	88.9	89.1	-	
DE-28		GUNDEMMINGEN-C (GUN-C)	BWR	BWR-72	3840	1344	1288	KGK	1976-7	1984-11	1985-1	88.3	88.4	-	
DE-31		ISAR-2 (IKI 2)	PWR	Konvoi	3950	1485	1410	E.ON	1982-9	1988-4	1988-4	93.8	93.9	-	
DE-44		NECKARWESTHEIM-2 (GKN 2)	PWR	Konvoi	3850	1400	1310	EnKK	1982-11	1989-1	1989-4	92.5	92.8	-	
HUNGARY	DE-24	PHILIPPSBURG-2 (KKP 2)	PWR	PWR	3950	1468	1402	EnKK	1977-7	1984-12	1985-4	90.7	91.9	-	
	HU-1	PAKS-1	PWR	VVER V-213	1485	500	470	PAKS Zrt	1974-8	1982-12	1983-8	86.7	86.7	-	
	HU-2	PAKS-2	PWR	VVER V-213	1485	500	473	PAKS Zrt	1974-8	1984-11	1984-11	87.6	87.6	DH	
	HU-3	PAKS-3	PWR	VVER V-213	1485	500	473	PAKS Zrt	1979-10	1986-9	1986-12	88.2	88.2	DH	
	HU-4	PAKS-4	PWR	VVER V-213	1485	500	473	PAKS Zrt	1979-10	1987-8	1987-11	88.3	88.3	DH	
	INDIA	IN-13	KAIGA-1	PHWR	Horizontal Pre	801	220	202	NPCIL	1989-9	2000-10	2000-11	57.6	90.0	-
		IN-14	KAIGA-2	PHWR	Horizontal Pre	801	220	202	NPCIL	1989-12	1999-12	2000-3	56.4	92.6	-
		IN-15	KAIGA-3	PHWR	Horizontal Pre	800	220	202	NPCIL	2002-3	2007-4	2007-5	45.1	72.9	-
IN-16		KAIGA-4	PHWR	Horizontal Pre	800	220	202	NPCIL	2002-5	2011-1	2011-1	71.7	93.5	-	
IN-9		KAKRAPAR-1	PHWR	Horizontal Pre	801	220	202	NPCIL	1984-12	1992-11	1993-5	35.9	45.3	-	
IN-10		KAKRAPAR-2	PHWR	Horizontal Pre	801	220	202	NPCIL	1985-4	1995-3	1995-9	62.5	94.3	-	
	IN-5	MADRAS-1	PHWR	Horizontal Pre	801	220	205	NPCIL	1971-1	1983-7	1984-1	47.5	80.7	DS	
	IN-6	MADRAS-2	PHWR	Horizontal Pre	801	220	205	NPCIL	1972-10	1985-9	1986-3	50.9	91.2	DS	

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DH district heating, DS desalination.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics
	Code	Name			Thermal	Gross	Net								
	IN-7	NARORA-1	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	1976-12	1989-7	1991-1	36.8	68.0	-
	IN-8	NARORA-2	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	1977-11	1992-1	1992-7	18.7	34.8	-
	IN-3	RAJASTHAN-1	PHWR	Horizontal Pre	346	100	90	NPCIL	AECL	1965-8	1972-11	1973-12	0.0	0.0	PH
	IN-4	RAJASTHAN-2	PHWR	Horizontal Pre	693	200	187	NPCIL	AEC/D/DAE	1968-4	1980-11	1981-4	50.3	53.4	PH
	IN-11	RAJASTHAN-3	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	1990-2	2000-3	2000-6	71.5	91.4	PH
	IN-12	RAJASTHAN-4	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	1990-10	2000-11	2000-12	70.1	89.6	PH
	IN-19	RAJASTHAN-5	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	2002-9	2009-12	2010-2	90.7	91.7	-
	IN-20	RAJASTHAN-6	PHWR	Horizontal Pre	801	220	202	NPCIL	NPCIL	2003-1	2010-3	2010-3	65.3	66.1	-
	IN-1	TARAPUR-1	BWR	BWR-1, Mark 2	530	160	150	NPCIL	GE	1964-10	1969-4	1969-10	85.8	86.4	-
	IN-2	TARAPUR-2	BWR	BWR-1, Mark 2	530	160	150	NPCIL	GE	1964-10	1969-5	1969-10	91.4	91.9	-
	IN-23	TARAPUR-3	PHWR	Horizontal Pre	1730	540	490	NPCIL	NPCIL	2000-5	2006-6	2006-8	66.3	92.1	-
	IN-24	TARAPUR-4	PHWR	Horizontal Pre	1730	540	490	NPCIL	NPCIL	2000-3	2005-6	2005-9	56.1	84.9	-
IRAN, ISL. REP.	IR-1	BUSHEHR 1	PWR	VVER V-446	3000	1000	915	NPPDCO	ASE	1975-5	2011-9	2012-7	-	-	-
JAPAN	JP-17	FUKUSHIMA-DAIICHI-5	BWR	BWR-4	2381	784	760	TEPCO	TOSHIBA	1972-5	1979-9	1978-4	61.6	61.6	-
	JP-18	FUKUSHIMA-DAIICHI-6	BWR	BWR-5	3293	1100	1067	TEPCO	GE/T	1973-10	1979-5	1979-10	59.0	60.4	-
	JP-25	FUKUSHIMA-DAINI-1	BWR	BWR-5	3293	1100	1067	TEPCO	TOSHIBA	1976-3	1981-7	1982-4	69.1	70.2	-
	JP-26	FUKUSHIMA-DAINI-2	BWR	BWR-5	3293	1100	1067	TEPCO	HITACHI	1979-5	1983-6	1984-2	65.4	66.6	-
	JP-35	FUKUSHIMA-DAINI-3	BWR	BWR-5	3293	1100	1067	TEPCO	TOSHIBA	1981-3	1984-12	1985-6	68.5	69.7	-
	JP-38	FUKUSHIMA-DAINI-4	BWR	BWR-5	3293	1100	1067	TEPCO	HITACHI	1981-5	1986-12	1987-8	62.3	63.5	-
	JP-12	GENKAI-1	PWR	M (2-loop)	1650	559	529	KYUSHU	MHI	1971-9	1975-2	1975-10	85.0	85.0	-
	JP-27	GENKAI-2	PWR	M (2-loop)	1650	559	529	KYUSHU	MHI	1977-2	1980-6	1981-3	64.4	64.4	-
	JP-45	GENKAI-3	PWR	M (4-loop)	3423	1180	1127	KYUSHU	MHI	1988-6	1993-6	1994-3	67.0	67.0	DS
	JP-46	GENKAI-4	PWR	M (4-loop)	3423	1180	1127	KYUSHU	MHI	1992-7	1996-11	1997-7	86.6	86.6	DS
	JP-36	HAMAOKA-3	BWR	BWR-5	3293	1100	1056	CHUBU	TOSHIBA	1983-4	1987-1	1987-8	66.7	67.0	-
	JP-49	HAMAOKA-4	BWR	BWR-5	3293	1137	1092	CHUBU	TOSHIBA	1988-10	1993-1	1993-9	79.1	81.2	-
	JP-60	HAMAOKA-5	BWR	ABWR	3926	1380	1325	CHUBU	TOSHIBA	2000-7	2004-4	2005-1	49.2	61.0	-
	JP-58	HIGASHI DORI 1 (TOHOKU)	BWR	BWR-5	3293	1100	1067	TOHOKU	TOSHIBA	2000-11	2005-3	2005-12	63.9	63.9	-
	JP-23	IKATA-1	PWR	M (2-loop)	1650	566	538	SHIKOKU	MHI	1973-9	1977-2	1977-9	76.4	76.5	DS

Note: The column "Non-electrical applications" indicates the use of the facility to provide: PH process heating, DS desalination.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics
	Code	Name			Thermal	Gross								
	JP-37	IKATA-2	PWR	M (2-loop)	1650	566	SHIKOKU	MHI	1978-8	1981-8	1982-3	85.1	85.2	DS
	JP-42	IKATA-3	PWR	M (3-loop)	2660	890	SHIKOKU	MHI	1990-10	1994-3	1994-12	77.7	77.7	DS
	JP-33	KASHIWAZAKI KARIWA-1	BWR	BWR-5	3293	1100	TEPCO	TOSHIBA	1980-6	1985-2	1985-9	29.9	35.5	-
	JP-39	KASHIWAZAKI KARIWA-2	BWR	BWR-5	3293	1100	TEPCO	TOSHIBA	1985-11	1990-2	1990-9	4.0	4.0	-
	JP-52	KASHIWAZAKI KARIWA-3	BWR	BWR-5	3293	1100	TEPCO	TOSHIBA	1989-3	1992-12	1993-8	10.7	14.3	-
	JP-53	KASHIWAZAKI KARIWA-4	BWR	BWR-5	3293	1100	TEPCO	HITACHI	1990-3	1993-12	1994-8	10.8	20.0	-
	JP-40	KASHIWAZAKI KARIWA-5	BWR	BWR-5	3293	1100	TEPCO	HITACHI	1985-6	1989-9	1990-4	21.7	31.9	-
	JP-56	KASHIWAZAKI KARIWA-6	BWR	ABWR	3926	1356	TEPCO	TOSHIBA	1992-11	1996-1	1996-11	47.2	55.4	-
	JP-4	KASHIWAZAKI KARIWA-7	BWR	ABWR	3926	1356	TEPCO	HITACHI	1993-7	1996-12	1997-7	47.9	54.6	-
	JP-4	MIHAMA-1	PWR	M (2-loop)	1031	340	KEPCO	WH	1967-2	1970-8	1970-11	53.1	53.4	-
	JP-6	MIHAMA-2	PWR	M (2-loop)	1456	500	KEPCO	MHI	1968-5	1972-4	1972-7	64.2	64.4	-
	JP-14	MIHAMA-3	PWR	M (3-loop)	2440	826	KEPCO	MHI	1972-8	1976-2	1976-12	71.6	71.6	-
	JP-15	OHI-1	PWR	W (4-loop)	3423	1175	KEPCO	WH	1972-10	1977-12	1979-3	63.5	63.5	DS
	JP-19	OHI-2	PWR	W (4-loop)	3423	1175	KEPCO	WH	1972-12	1978-10	1979-12	77.0	77.0	DS
	JP-50	OHI-3	PWR	M (4-loop)	3423	1180	KEPCO	MHI	1987-10	1991-6	1991-12	62.0	62.0	-
	JP-51	OHI-4	PWR	M (4-loop)	3423	1180	KEPCO	MHI	1988-6	1992-6	1993-2	75.8	75.8	-
	JP-22	ONAGAWA-1	BWR	BWR-4	1593	524	TOHOKU	TOSHIBA	1980-7	1983-11	1984-6	42.4	52.3	-
	JP-54	ONAGAWA-2	BWR	BWR-5	2436	825	TOHOKU	TOSHIBA	1991-4	1994-12	1995-7	59.8	69.2	-
	JP-57	ONAGAWA-3	BWR	BWR-5	2436	825	TOHOKU	TOSHIBA	1998-1	2001-5	2002-1	52.4	62.4	-
	JP-28	SENDAI-1	PWR	M (3-loop)	2660	890	KYUSHU	MHI	1979-12	1983-9	1984-7	69.0	69.0	-
	JP-37	SENDAI-2	PWR	M (3-loop)	2660	890	KYUSHU	MHI	1981-10	1985-4	1985-11	78.7	78.7	-
	JP-48	SHIKA-1	BWR	BWR-5	1593	540	HOKURIKU	HITACHI	1989-7	1993-1	1993-7	35.9	35.9	-
	JP-59	SHIKA-2	BWR	ABWR	3926	1206	HOKURIKU	HITACHI	2001-8	2005-7	2006-3	42.7	42.7	-
	JP-7	SHIMANE-1	BWR	BWR-3	1380	460	CHUGOKU	HITACHI	1970-7	1973-12	1974-3	46.4	46.4	-
	JP-41	SHIMANE-2	BWR	BWR-5	2436	820	CHUGOKU	HITACHI	1985-2	1989-2	1989-2	70.6	70.6	-
	JP-8	TAKAHAMA-1	PWR	M (3-loop)	2440	826	KEPCO	WH/MHI	1970-4	1974-3	1974-11	67.4	67.4	-
	JP-13	TAKAHAMA-2	PWR	M (3-loop)	2440	826	KEPCO	MHI	1971-3	1975-1	1975-11	71.2	71.2	-
	JP-29	TAKAHAMA-3	PWR	M (3-loop)	2660	870	KEPCO	MHI	1980-12	1985-1	1985-5	76.8	76.8	DS
	JP-30	TAKAHAMA-4	PWR	M (3-loop)	2660	870	KEPCO	MHI	1981-3	1984-11	1985-6	73.2	73.2	DS
	JP-21	TOKAI-2	BWR	BWR-5	3293	1100	JAPCO	GE	1973-10	1978-3	1978-11	56.1	59.9	-

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DS desalination.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics
	Code	Name			Thermal	Gross	Net								
KOREA, REP. OF	JP -43	TOMARI-1	PWR	M (2-loop)	1650	579	550	HEPCO	MHI	1985-4	1988-12	1989-6	71.1	71.1	-
	JP -44	TOMARI-2	PWR	M (2-loop)	1650	579	550	HEPCO	MHI	1985-6	1991-4	1991-4	74.6	74.6	-
	JP -64	TOMARI-3	PWR	M (3-loop)	2860	912	866	HEPCO	MHI	2004-11	2009-3	2009-12	91.4	91.4	-
	JP -3	TSURUGA-1	BWR	BWR-2	1070	357	340	JAPCO	GE	1966-11	1969-11	1970-3	42.8	43.0	-
	JP -34	TSURUGA-2	PWR	M (4-loop)	3411	1160	1108	JAPCO	MHI	1982-11	1986-6	1987-2	50.9	51.7	-
	KR -1	KORI-1	PWR	WH & #9651;60	1729	603	576	KHNP	WH	1972-4	1977-6	1978-4	94.4	95.0	-
	KR -2	KORI-2	PWR	WH F	1882	675	637	KHNP	WH	1977-12	1983-4	1983-7	91.4	91.4	-
	KR -5	KORI-3	PWR	WH F	2912	1042	1011	KHNP	WH	1979-10	1985-1	1985-9	92.9	92.9	-
	KR -6	KORI-4	PWR	WH F	2912	1042	1009	KHNP	WH	1980-4	1985-11	1986-4	92.2	92.4	-
	KR -21	SHIN-KORI-1	PWR	OPR-1000	2825	1038	985	KHNP	DHICKOPC	2006-6	2010-8	2011-2	99.6	100.0	-
KR -9	ULCHIN-1	PWR	France CPI	2785	985	945	KHNP	FRAM	1983-1	1988-4	1989-9	93.4	93.6	-	
KR -10	ULCHIN-2	PWR	France CPI	2775	984	942	KHNP	FRAM	1983-7	1989-4	1989-9	89.6	89.6	-	
KR -13	ULCHIN-3	PWR	OPR-1000	2825	1047	994	KHNP	DHICKOPC	1993-7	1998-1	1998-8	93.0	93.1	-	
KR -14	ULCHIN-4	PWR	OPR-1000	2825	1045	998	KHNP	DHICKOPC	1993-11	1998-12	1999-12	88.5	88.6	-	
KR -19	ULCHIN-5	PWR	OPR-1000	2815	1048	997	KHNP	DHICKOPC	1999-10	2003-12	2004-7	93.6	93.7	-	
KR -20	ULCHIN-6	PWR	OPR-1000	2825	1048	997	KHNP	DHICKOPC	2000-9	2005-1	2005-4	93.4	93.6	-	
KR -3	WOLSONG-1	PHWR	CANDU 6	2061	689	660	KHNP	AECI	1977-10	1982-12	1983-4	50.1	50.1	-	
KR -4	WOLSONG-2	PHWR	CANDU 6	2061	740	710	KHNP	AECI/DHI	1992-6	1997-4	1997-7	93.5	93.7	-	
KR -15	WOLSONG-3	PHWR	CANDU 6	2061	729	707	KHNP	AECI/DHI	1994-3	1998-3	1998-7	94.7	94.8	-	
KR -16	WOLSONG-4	PHWR	CANDU 6	2061	730	708	KHNP	AECI/DHI	1994-7	1999-5	1999-10	93.3	93.4	-	
KR -7	YONGGANG-1	PWR	WH F	2787	985	953	KHNP	WH	1981-6	1986-3	1986-8	91.6	91.9	-	
KR -8	YONGGANG-2	PWR	WH F	2787	978	947	KHNP	WH	1981-12	1986-11	1987-6	90.5	90.8	-	
KR -11	YONGGANG-3	PWR	OPR-1000	2825	1039	997	KHNP	DHICKAEC	1989-12	1994-10	1995-3	92.3	92.5	-	
KR -12	YONGGANG-4	PWR	OPR-1000	2825	1039	994	KHNP	DHICKAEC	1990-5	1996-7	1996-1	91.5	91.8	-	
KR -17	YONGGANG-5	PWR	OPR-1000	2825	1046	988	KHNP	DHICKOPC	1997-6	2001-12	2002-5	94.2	94.2	-	
KR -18	YONGGANG-6	PWR	OPR-1000	2825	1050	996	KHNP	DHICKOPC	1997-11	2002-9	2002-12	92.5	92.8	-	
MEXICO	MX -1	LAGUNA VERDE-1	BWR	BWR-5	2027	682	650	CFE	GE	1976-10	1989-4	1990-7	75.8	76.1	-
	MX -2	LAGUNA VERDE-2	BWR	BWR-5	2027	682	650	CFE	GE	1977-6	1994-11	1995-4	82.3	82.8	-

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007-2011	UCF % 2007-2011	Non-electrical applics
	Code	Name			Thermal	Gross								
NETHERLANDS	NL-2	BORSSELE	PWR	LWR - PWR	1366	515	482	EPZ	1969-7	1973-7	1973-10	92.7	93.0	-
	PK-2	CHASNUPP 1	PWR	CNP-300	999	325	300	PAEC	1993-8	2000-6	2000-9	74.0	74.1	-
	PK-3	CHASNUPP 2	PWR	PWR	999	325	300	PAEC	2005-12	2011-3	2011-5	88.3	88.3	-
PAKISTAN	PK-1	KANUPP	PHWR	CANDU-137 M	433	137	125	PAEC	1966-8	1971-10	1972-12	45.7	45.7	DS
	RO-1	CERNAVODA-1	PHWR	CANDU 6	2180	706	650	SNN	1982-7	1996-7	1996-12	93.6	94.1	DH
	RO-2	CERNAVODA-2	PHWR	CANDU 6	2180	706	650	SNN	1983-7	2007-8	2007-10	93.8	94.6	DH
RUSSIA	RU-96	BALAKOVO-1	PWR	VVER V-320	3000	1000	950	REA	1980-12	1985-12	1986-5	86.9	87.4	DH, PH
	RU-97	BALAKOVO-2	PWR	VVER V-320	3000	1000	950	REA	1981-8	1987-10	1988-1	88.1	89.2	DH, PH
	RU-98	BALAKOVO-3	PWR	VVER V-320	3000	1000	950	REA	1982-11	1988-12	1989-4	88.5	89.5	DH, PH
	RU-99	BALAKOVO-4	PWR	VVER V-320	3200	1000	950	REA	1984-4	1993-4	1993-12	88.0	88.8	DH, PH
	RU-21	BELOYARSKY-3 (BN-600)	FBR	BN-600	1470	600	560	REA	1969-1	1980-4	1981-11	76.5	76.6	DH, PH
	RU-141	BILIBINO-1	LWGR	EGP-6	62	12	11	REA	1970-1	1974-1	1974-4	44.3	53.3	DH
	RU-142	BILIBINO-2	LWGR	EGP-6	62	12	11	REA	1970-1	1974-12	1975-2	75.5	84.8	DH
	RU-143	BILIBINO-3	LWGR	EGP-6	62	12	11	REA	1970-1	1975-12	1976-2	76.3	85.7	DH
	RU-144	BILIBINO-4	LWGR	EGP-6	62	12	11	REA	1970-1	1976-12	1977-1	74.2	83.4	DH
	RU-30	KALININ-1	PWR	VVER V-338	3000	1000	950	REA	1970-1	1985-5	1985-6	84.7	84.9	DH, PH
	RU-31	KALININ-2	PWR	VVER V-338	3000	1000	950	REA	1977-2	1984-5	1985-6	85.9	86.2	DH, PH
	RU-36	KALININ-3	PWR	VVER V-320	3200	1000	950	REA	1982-2	1986-12	1987-3	85.9	86.2	DH, PH
	RU-37	KALININ-4	PWR	VVER V-320	3200	1000	950	REA	1985-10	2004-12	2005-11	85.1	85.3	PH
	RU-12	KOLA-1	PWR	VVER V-230	1375	440	411	REA	1986-8	2011-11	—	82.4	85.7	DH, PH
	RU-13	KOLA-2	PWR	VVER V-230	1375	440	411	REA	1970-5	1973-6	1973-12	82.4	86.0	DH, PH
	RU-32	KOLA-3	PWR	VVER V-213	1375	440	411	REA	1970-5	1974-12	1975-2	82.4	86.0	DH, PH
	RU-33	KOLA-4	PWR	VVER V-213	1375	440	411	REA	1977-4	1981-3	1982-12	72.2	78.7	DH, PH
	RU-17	KURSK-1	LWGR	RBMK-1000	3200	1000	925	REA	1976-8	1984-10	1984-12	80.9	84.6	DH, PH
	RU-22	KURSK-2	LWGR	RBMK-1000	3200	1000	925	REA	1972-6	1976-12	1977-10	82.8	84.8	DH, PH
RU-38	KURSK-3	LWGR	RBMK-1000	3200	1000	925	REA	1973-1	1979-1	1979-8	78.4	78.6	DH, PH	
RU-39	KURSK-4	LWGR	RBMK-1000	3200	1000	925	REA	1978-4	1983-10	1984-3	70.7	71.4	DH, PH	
							REA	1981-5	1985-12	1986-2	74.7	75.6	DH, PH	

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DS desalination, DH district heating, PH process heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF %		Non-electrical applics
	Code	Name			Thermal	Gross						Net	2007-2011	
SLOVAKIA	RU-15	LENINGRAD-1	LWGR	RBMK-1000	3200	1000	925	REA	1970-3	1973-12	1974-11	79.2	80.2	DH, PH
	RU-16	LENINGRAD-2	LWGR	RBMK-1000	3200	1000	925	REA	1970-6	1975-7	1976-2	86.9	87.3	DH, PH
	RU-34	LENINGRAD-3	LWGR	RBMK-1000	3200	1000	925	REA	1973-12	1979-12	1980-6	71.3	72.8	DH, PH
	RU-35	LENINGRAD-4	LWGR	RBMK-1000	3200	1000	925	REA	1975-2	1981-2	1981-8	70.5	71.7	DH, PH
	RU-9	NOVOVORONEZH-3	PWR	VVER V-179	1375	417	385	REA	1967-7	1971-12	1972-6	65.2	66.0	DH, PH
	RU-11	NOVOVORONEZH-4	PWR	VVER V-179	1375	417	385	REA	1967-7	1972-12	1973-3	80.6	81.8	DH, PH
	RU-20	NOVOVORONEZH-5	PWR	VVER V-187	3000	1000	950	REA	1974-3	1980-5	1981-2	67.0	67.8	DH, PH
	RU-59	ROSTOV-1	PWR	VVER V-3201	3200	1000	950	REA	1981-9	2001-3	2001-12	88.2	88.3	-
	RU-62	ROSTOV-2	PWR	VVER V-3201	3200	1000	950	REA	1983-5	2010-3	2010-12	89.4	90.2	-
	RU-23	SMOLENSK-1	LWGR	RBMK-1000	3200	1000	925	REA	1975-10	1982-12	1983-9	75.9	76.3	DH, PH
	RU-24	SMOLENSK-2	LWGR	RBMK-1000	3200	1000	925	REA	1976-6	1985-5	1985-7	79.7	80.2	DH, PH
RU-67	SMOLENSK-3	LWGR	RBMK-1000	3200	1000	925	REA	1984-5	1990-1	1990-10	79.1	79.3	DH, PH	
SLOVAKIA	SK-13	BOHUNICE-3	PWR	VVER V-213	1471	505	472	SE,plc	1976-12	1984-8	1985-2	83.5	85.8	DH, PH
	SK-14	BOHUNICE-4	PWR	VVER V-213	1471	505	472	SE,plc	1976-12	1985-8	1985-12	84.7	86.7	DH, PH
	SK-6	MOCHOVCE-1	PWR	VVER V-213	1471	470	436	SE,plc	1983-10	1998-7	1998-10	89.2	89.6	-
SK-7	MOCHOVCE-2	PWR	VVER V-213	1471	470	436	SE,plc	1983-10	1999-12	2000-4	89.1	89.8	-	
SLOVENIA	SI-1	KRSKO	PWR	Westinghouse 2	1994	727	688	NEK	1975-3	1981-10	1983-1	93.7	93.8	-
SOUTH AFRICA	ZA-1	KOEBERG-1	PWR	CP1	2775	970	930	ESKOM	1976-7	1984-4	1984-7	80.9	81.4	-
	ZA-2	KOEBERG-2	PWR	CP1	2775	940	900	ESKOM	1976-7	1985-7	1985-11	79.1	81.8	-
SPAIN	ES-6	ALMARAZ-1	PWR	WE 3-loops	2947	1045	1011	CNAT	1973-7	1981-5	1983-9	88.6	89.6	-
	ES-7	ALMARAZ-2	PWR	WE 3-loops	2947	1044	1006	CNAT	1973-7	1983-10	1984-7	87.8	88.8	-
	ES-8	ASCO-1	PWR	WE 3-loops	2941	1033	995	ANAV	1974-5	1983-8	1984-12	80.8	82.0	-
	ES-9	ASCO-2	PWR	WE 3-loops	2941	1027	997	ANAV	1975-3	1985-10	1986-3	83.8	85.6	-
	ES-10	COFRENTES	BWR	BWR-6	3237	1092	1064	ID	1975-9	1984-10	1985-3	82.4	83.9	-
	ES-2	SANTA MARIA DE GARONA	BWR	BWR-3	1381	466	446	NUCLEONOR GE	1966-9	1971-3	1971-5	91.1	91.5	-
ES-11	TRILLO-1	PWR	PWR 3-loops	3010	1066	1003	CNAT	1979-8	1988-5	1988-8	87.9	88.3	-	

Note: The column "Non-electrical applications" indicates the use of the facility to provide: DH district heating, PH process heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007-2011	UCF % 2007-2011	Non-electrical applics
	Code	Name			Thermal	Gross								
SWEDEN	ES-16	VANDELLOS-2	PWR	WE 3-loops	1087	1045	ANAV	WH	1980-12	1987-12	1988-3	72.2	73.2	-
	SE-9	FORSMARK-1	BWR	BWR-75	2928	1022	984	ABBATOM	1973-6	1980-6	1980-12	84.1	84.7	-
	SE-11	FORSMARK-2	BWR	BWR-75	2928	1034	996	FKA	1975-1	1981-1	1981-7	71.9	72.4	-
	SE-14	FORSMARK-3	BWR	BWR-3000	3300	1212	1170	FKA	1979-1	1985-3	1985-8	81.3	82.1	-
	SE-2	OSKARSHAMN-1	BWR	ABB BWR	1375	492	473	OKG	1966-8	1971-8	1972-2	73.8	75.1	-
	SE-3	OSKARSHAMN-2	BWR	ABB BWR	1800	661	638	OKG	1969-9	1974-10	1975-1	81.4	82.8	-
	SE-12	OSKARSHAMN-3	BWR	BWR-75	3900	1450	1400	OKG	1980-5	1985-3	1985-8	54.7	55.6	-
	SE-4	RINGHALS-1	BWR	BWR	2540	893	854	RAB	1968-2	1974-10	1976-1	56.9	58.1	-
	SE-5	RINGHALS-2	PWR	WE (3 loops)	2660	917	809	RAB	1970-10	1974-8	1975-5	61.2	62.5	-
	SE-7	RINGHALS-3	PWR	WE (3 loops)	3135	1102	1057	WH	1972-9	1980-9	1981-9	80.1	82.1	-
SE-10	RINGHALS-4	PWR	WE (3 loops)	2775	981	945	RAB	1973-11	1982-6	1983-11	81.1	82.9	-	
SWITZERLAND	CH-1	BEZNAU-1	PWR	WH - 2 loops	1130	380	365	Axpo AG	1965-9	1969-7	1969-9	93.1	93.1	DH
	CH-3	BEZNAU-2	PWR	WH - 2 loops	1130	380	365	Axpo AG	1968-1	1971-10	1971-12	90.0	90.0	DH
	CH-4	GOESGEN	PWR	PWR 3 Loop	3002	1035	970	KKW	1973-12	1979-2	1979-11	93.2	93.4	PH
	CH-5	LEIBSTADT	BWR	BWR-6	3600	1245	1190	KKL	1974-1	1984-5	1984-12	90.3	91.2	-
	CH-2	MUEHLEBERG	BWR	BWR-4	1097	390	373	BKW	1967-3	1971-7	1972-11	87.9	88.0	-
UK	GB-18A	DUNGENESS-B1	GCR	AGR	1500	615	520	APC	1965-10	1983-4	1985-4	36.3	36.3	-
	GB-18B	DUNGENESS-B2	GCR	AGR	1500	615	520	APC	1965-10	1985-12	1989-4	45.1	45.1	-
	GB-19A	HARTLEPOOL-A1	GCR	AGR	1500	655	595	APC	1968-10	1983-8	1989-4	56.6	56.6	-
	GB-19B	HARTLEPOOL-A2	GCR	AGR	1500	655	595	NPC	1968-10	1984-10	1989-4	55.7	55.7	-
	GB-20A	HEYSHAM-A1	GCR	AGR	1500	625	585	NPC	1970-12	1983-7	1989-4	52.6	52.6	-
	GB-20B	HEYSHAM-A2	GCR	AGR	1500	625	575	NPC	1970-12	1984-10	1989-4	48.6	48.6	-
	GB-22A	HEYSHAM-B1	GCR	AGR	1550	680	605	NPC	1980-8	1988-7	1989-4	82.4	82.7	-
	GB-22B	HEYSHAM-B2	GCR	AGR	1550	680	605	NPC	1980-8	1988-11	1989-4	69.5	70.0	-
	GB-16A	HINKLEY POINT-B1	GCR	AGR	1494	655	435	TNPG	1967-9	1976-10	1978-10	67.6	67.9	-
	GB-16B	HINKLEY POINT-B2	GCR	AGR	1494	655	435	BE	1967-9	1976-2	1976-9	70.4	70.4	-
GB-17A	HUNTERSTON-B1	GCR	AGR	1496	644	460	BE	1967-11	1976-2	1976-2	67.9	67.9	-	

Note: The column Non-Electrical Applications indicates the use of the facility to provide: DH district heating, PH process heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics
	Code	Name			Thermal	Gross								
	GB-17B	HUNTERSTON-B2	GCR	AGR	1496	644	430	TNPG	1967-11	1977-3	1977-3	70.0	70.1	-
	GB-11A	OLDBURY-A1	GCR	MAGNOX	730	230	217	MEL	1962-5	1967-11	1967-12	41.1	41.1	-
	GB-24	SIZEWELL-B	PWR	SNUPPS	3425	1250	1191	PPC	1988-7	1995-2	1995-9	80.7	80.7	-
	GB-23A	TORNESSE 1	GCR	AGR	1623	682	600	BE	1980-8	1988-5	1988-5	75.5	76.1	-
	GB-23B	TORNESSE 2	GCR	AGR	1623	682	600	BE	1980-8	1988-5	1989-2	84.8	85.8	-
	GB-13A	WYLFA 1	GCR	MAGNOX	1920	540	490	MEL	1963-9	1971-1	1971-11	63.4	63.7	-
	GB-13B	WYLFA 2	GCR	MAGNOX	1920	540	490	MEL	1963-9	1971-7	1972-1	59.4	59.6	-
UKRAINE	UA-40	KHMELNITSKI-1	PWR	VVER V-320	3000	1000	950	NNEGC	1981-11	1987-12	1988-8	80.7	81.4	DH
	UA-41	KHMELNITSKI-2	PWR	VVER V-320	3000	1000	950	NNEGC	1985-2	2004-8	2005-12	74.0	74.8	DH
	UA-27	ROVNO-1	PWR	VVER V-213	1375	420	381	NNEGC	1973-8	1980-12	1981-9	58.0	58.4	DH
	UA-28	ROVNO-2	PWR	VVER V-213	1375	415	376	NNEGC	1973-10	1981-12	1982-7	70.7	71.4	DH
	UA-29	ROVNO-3	PWR	VVER V-320	3000	1000	950	NNEGC	1980-2	1986-12	1987-5	67.1	69.1	DH
	UA-69	ROVNO-4	PWR	VVER V-320	3000	1000	950	NNEGC	1986-8	2004-10	2006-4	70.0	72.6	DH
	UA-44	SOUTH UKRAINE-1	PWR	VVER V-302	3000	1000	950	NNEGC	1977-3	1982-12	1983-10	73.1	77.7	DH
	UA-45	SOUTH UKRAINE-2	PWR	VVER V-338	3000	1000	950	NNEGC	1979-10	1985-4	1985-4	77.7	79.5	DH
	UA-48	SOUTH UKRAINE-3	PWR	VVER V-320	3000	1000	950	NNEGC	1985-2	1989-9	1989-12	65.5	71.4	DH
	UA-54	ZAPOROZHE-1	PWR	VVER V-320	3000	1000	950	NNEGC	1980-4	1984-12	1985-12	80.4	81.4	DH
	UA-56	ZAPOROZHE-2	PWR	VVER V-320	3000	1000	950	NNEGC	1981-1	1985-7	1986-2	81.0	82.1	DH
	UA-78	ZAPOROZHE-3	PWR	VVER V-320	3000	1000	950	NNEGC	1982-4	1986-12	1987-3	82.8	85.5	DH
	UA-79	ZAPOROZHE-4	PWR	VVER V-320	3000	1000	950	NNEGC	1983-4	1987-12	1988-4	82.1	83.6	DH
	UA-126	ZAPOROZHE-5	PWR	VVER V-320	3000	1000	950	NNEGC	1985-11	1989-8	1989-10	81.7	83.0	DH
	UA-127	ZAPOROZHE-6	PWR	VVER V-320	3000	1000	950	NNEGC	1986-6	1995-10	1996-9	82.4	82.8	DH
	USA	US-313	ARKANSAS ONE-1	PWR	B&W (L-loop) D	2568	880	842	ENTERGY	1968-10	1974-8	1974-12	91.4	91.4
US-368		ARKANSAS ONE-2	PWR	CE (2-loop) DR	3026	1040	993	ENTERGY	1968-12	1978-12	1980-3	93.9	93.9	-
US-334		BEAVER VALLEY-1	PWR	W (3-loop)	2889	923	892	FENOC	1970-6	1976-6	1976-10	94.6	94.6	-
US-412		BEAVER VALLEY-2	PWR	W (3-loop)	2689	923	885	FENOC	1974-5	1987-8	1987-11	93.0	93.0	-
US-456		BRAIDWOOD-1	PWR	W (4-loop)	3587	1240	1178	EXELON	1975-8	1987-7	1988-7	95.2	95.3	-
US-457		BRAIDWOOD-2	PWR	W (4-loop) DRY	3587	1213	1152	EXELON	1975-8	1988-5	1988-10	95.2	95.3	-

Note: The column Non-Electrical Applications indicates the use of the facility to provide: DH district heating.

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007-2011	UCF % 2007-2011	Non-electrical applics
	Code	Name			Thermal	Gross								
	US-289	BROWNS FERRY-1	BWR	BWR-4 (Mark 1)	3458	1152	1101	TVA	1967-5	1973-10	1974-8	90.3	91.7	-
	US-280	BROWNS FERRY-2	BWR	BWR-4 (Mark 1)	3458	1155	1104	TVA	1967-5	1974-8	1975-3	87.6	89.1	-
	US-296	BROWNS FERRY-3	BWR	BWR-4 (Mark 1)	3458	1400	1105	TVA	1968-7	1976-9	1975-3	88.6	90.5	-
	US-325	BRUNSWICK-1	BWR	BWR-4 (Mark 1)	2923	990	938	PROGRESS	1970-2	1976-12	1977-3	91.6	91.6	-
	US-324	BRUNSWICK-2	BWR	BWR-4 (Mark 1)	2923	989	920	PROGRESS	1970-2	1975-4	1975-11	88.5	88.5	-
	US-454	BYRON-1	PWR	W (4-loop) (DR)	3587	1225	1164	EXELON	1975-4	1985-3	1985-9	94.6	94.6	-
	US-455	BYRON-2	PWR	W (4-loop) (DR)	3587	1196	1136	EXELON	1975-4	1987-2	1987-8	94.1	94.1	-
	US-483	CALLAWAY-1	PWR	W (4-loop) (DR)	3565	1236	1190	Ameren/UE	1975-9	1984-10	1984-12	89.4	89.4	-
	US-317	CALVERT CLIFFS-1	PWR	CE (2-loop) (D)	2700	918	855	CONSTELL	1968-6	1975-5	1975-5	96.1	96.3	-
	US-318	CALVERT CLIFFS-2	PWR	CE (2-loop) (D)	2700	911	850	CONSTELL	1968-6	1976-12	1977-4	94.6	94.6	-
	US-413	CATAWBA-1	PWR	W (4-loop) (IC)	3411	1188	1129	DUKEENER	1974-5	1985-1	1985-6	92.3	92.3	-
	US-414	CATAWBA-2	PWR	W (4-loop) (IC)	3411	1188	1129	DUKEENER	1974-5	1986-5	1986-8	92.2	92.2	-
	US-461	CLINTON-1	BWR	BWR-6 (Mark 3)	3473	1088	1065	EXELON	1975-10	1987-4	1987-11	94.8	94.8	-
	US-387	COLUMBIA	PWR	BWR-5 (Mark 2)	3486	1200	1131	ENERGYNW	1972-8	1984-5	1984-12	81.4	81.6	-
	US-445	COMANCHE PEAK-1	PWR	W (4-loop) (DR)	3612	1259	1209	LUMINANT	1974-12	1990-4	1990-8	92.7	92.7	-
	US-446	COMANCHE PEAK-2	PWR	W (4-loop) (DR)	3458	1250	1197	LUMINANT	1974-12	1993-4	1993-8	95.9	95.9	-
	US-288	COOPER	BWR	BWR-4 (Mark 1)	2381	801	774	ENERGY	1968-6	1974-5	1974-7	91.6	91.6	-
	US-302	CRYSTAL RIVER-3	PWR	B&W (L-loop)	2568	890	860	PROGRESS	1968-9	1977-1	1977-3	50.8	50.8	-
	US-346	DAVIS BESSE-1	PWR	B&W (R-loop)	2772	925	894	FENOC	1970-9	1977-8	1978-7	85.7	85.7	-
	US-275	DIABLO CANYON-1	PWR	W (4-loop)	3338	1136	1122	PG&E	1968-4	1984-11	1985-5	92.3	92.3	-
	US-323	DIABLO CANYON-2	PWR	W (4-loop)	3411	1164	1118	PG&E	1970-12	1985-10	1986-3	90.0	90.2	-
	US-315	DONALD COOK-1	PWR	W (4-loop) (ICE)	3304	1077	1009	AEP	1969-3	1975-2	1975-8	68.5	68.5	-
	US-316	DONALD COOK-2	PWR	W (4-loop) (ICE)	3468	1133	1077	AEP	1969-3	1978-3	1978-7	90.4	90.4	-
	US-237	DRESDEN-2	BWR	BWR-3 (Mark 1)	2527	913	867	EXELON	1966-1	1970-4	1970-6	95.2	95.2	-
	US-249	DRESDEN-3	BWR	BWR-3 (Mark 1)	2527	913	867	EXELON	1966-10	1971-11	1971-11	96.4	96.4	-
	US-331	DUANE ARNOLD-1	BWR	BWR-4 (Mark 1)	1912	614	601	NEXTERA	1970-6	1974-5	1975-2	92.2	92.2	-
	US-341	ENRICO FERMI-2	PWR	BWR-4 (Mark 1)	3430	1154	1085	DTEDISON	1972-9	1986-9	1988-1	89.1	89.1	-
	US-348	FARLEY-1	PWR	W (3-loop)	2775	895	874	SOUTHERN	1970-10	1977-8	1977-12	93.0	93.0	-
	US-364	FARLEY-2	PWR	W (3-loop) (DR)	2775	905	860	SOUTHERN	1970-10	1981-5	1981-7	90.2	90.2	-
	US-333	FITZPATRICK	BWR	BWR-4 (Mark 1)	2536	882	855	ENERGY	1968-9	1975-2	1975-7	95.5	96.1	-

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics
	Code	Name			Thermal	Gross	Net								
	US-285	FORT CALHOUN-1	PWR	CE (2-loop)	1500	512	482	OPPD	CE	1968-6	1973-8	1973-9	78.9	78.9	-
	US-416	GRAND GULF-1	BWR	BWR-6 (Mark 3)	3833	1333	1251	ENERGY	GE	1974-5	1984-10	1985-7	92.9	92.9	-
	US-281	H.B. ROBINSON-2	PWR	W (3-loop) DRY	2339	745	724	PROGRESS	WH	1967-4	1970-9	1971-3	85.6	85.6	-
	US-321	HATCH-1	BWR	BWR-4 (Mark 1)	2804	898	876	SOUTHERN	GE	1968-9	1974-11	1975-12	93.2	93.2	-
	US-366	HATCH-2	BWR	BWR-4 (Mark 1)	2804	921	883	SOUTHERN	GE	1972-2	1978-9	1979-9	87.3	87.3	-
	US-354	HOPE CREEK-1	BWR	BWR-4 (Mark 1)	3339	1376	1191	PSEG	GE	1976-3	1986-8	1986-12	94.4	94.4	-
	US-287	INDIAN POINT-2	PWR	W (4-loop) DRY	3216	1062	1022	ENERGY	WH	1966-10	1973-6	1974-8	94.4	94.4	-
	US-286	INDIAN POINT-3	PWR	W (4-loop) DRY	3216	1065	1040	ENERGY	WH	1968-11	1976-4	1976-8	92.8	92.8	-
	US-305	KEWAUNEE	PWR	W (2-loop) DRY	1772	581	566	DOMINION	WH	1968-8	1974-4	1974-6	93.3	93.3	-
	US-373	LASALLE-1	BWR	BWR-5 (Mark 2)	3489	1177	1118	EXELON	GE	1973-9	1982-9	1984-1	96.1	96.1	-
	US-374	LASALLE-2	BWR	BWR-5 (Mark 2)	3489	1179	1120	EXELON	GE	1973-9	1984-4	1984-10	96.1	96.1	-
	US-352	LIMERICK-1	BWR	BWR-4 (Mark 2)	3458	1194	1130	EXELON	GE	1974-6	1985-4	1986-2	96.6	96.6	-
	US-353	LIMERICK-2	BWR	BWR-4 (Mark 2)	3458	1194	1134	EXELON	GE	1974-6	1985-9	1990-1	94.5	94.5	-
	US-369	MCGUIRE-1	PWR	W (4-loop) ICE	3411	1158	1100	DUKEENER	WH	1971-4	1981-9	1981-12	88.5	88.5	-
	US-370	MCGUIRE-2	PWR	W (4-loop) IC	3411	1158	1100	DUKEENER	WH	1971-4	1983-5	1984-3	93.1	93.1	-
	US-336	MILLSTONE-2	PWR	COMB CE DRY	2700	910	869	DOMINION	CE	1969-11	1975-11	1975-12	90.7	91.1	-
	US-423	MILLSTONE-3	PWR	W (4-loop) DRY	3411	1253	1233	DOMINION	WH	1974-8	1986-4	1986-4	89.6	89.6	-
	US-263	MONTICELLO	BWR	BWR-3	1775	600	572	NSP	GE	1967-6	1971-3	1971-6	86.0	86.0	-
	US-220	NINE MILE POINT-1	BWR	BWR-2 (Mark 1)	1850	642	621	CONSTELL	GE	1965-4	1969-11	1969-12	94.0	94.0	-
	US-410	NINE MILE POINT-2	BWR	BWR-5 (Mark 2)	3467	1205	1119	CONSTELL	GE	1975-8	1987-8	1988-3	94.7	94.7	-
	US-338	NORTH ANNA-1	PWR	W (3-loop)	2893	973	920	DOMINION	WH	1971-2	1978-4	1978-6	88.8	93.3	-
	US-339	NORTH ANNA-2	PWR	W (3-loop)	2940	994	943	DOMINION	WH	1971-2	1980-8	1980-12	84.4	89.6	-
	US-289	OCONEE-1	PWR	B&W (L-loop)	2568	891	846	DUKEENER	B&W	1967-11	1973-5	1973-7	89.3	89.3	-
	US-270	OCONEE-2	PWR	B&W (L-loop)	2568	891	846	DUKEENER	B&W	1967-11	1973-12	1974-9	91.4	91.4	-
	US-287	OCONEE-3	PWR	B&W (L-loop)	2568	891	846	DUKEENER	B&W	1967-11	1974-9	1974-12	93.3	93.3	-
	US-219	OYSTER CREEK	BWR	BWR-2 (Mark 1)	1930	652	619	EXELON	GE	1964-12	1969-9	1969-12	93.3	93.4	-
	US-285	PALISADES	PWR	CE (2-loop) DR	2565	842	793	ENERGY	CE	1967-3	1971-12	1971-12	91.4	91.4	-
	US-528	PALO VERDE-1	PWR	CE (2-loop) DR	3990	1414	1311	APS	CE	1976-5	1986-1	1986-1	86.2	86.2	-
	US-529	PALO VERDE-2	PWR	COMB CE80 D	3990	1414	1314	APS	CE	1976-6	1986-5	1986-9	88.8	88.8	-
	US-530	PALO VERDE-3	PWR	COMB CE80 D	3990	1346	1312	APS	CE	1976-6	1987-11	1988-1	86.6	86.6	-

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applics	
	Code	Name			Thermal	Gross									Net
	US-277	PEACH BOTTOM-2	BWR	BWR-4 (Mark 1)	3514	1171	1122	EXELON	GE	1968-1	1974-2	1974-7	96.6	96.6	-
	US-278	PEACH BOTTOM-3	BWR	BWR-4 (Mark 1)	3514	1171	1122	EXELON	GE	1968-1	1974-9	1974-12	94.5	94.5	-
	US-440	PERRY-1	BWR	BWR-6 (Mark 3)	3240	1303	1240	FENOC	GE	1967-10	1987-11	1987-11	85.1	85.1	-
	US-293	PILGRIM-1	BWR	BWR-3 (Mark 1)	2028	711	685	ENTERGY	GE	1968-8	1972-7	1972-12	93.4	93.6	-
	US-286	POINT BEACH-1	PWR	W (2-loop) DRY	1540	543	512	NEXTERA	WH	1967-7	1970-11	1970-12	87.9	87.9	-
	US-301	POINT BEACH-2	PWR	W (2-loop) DRY	1800	645	586	NEXTERA	WH	1968-7	1972-8	1972-10	88.6	88.6	-
	US-282	PRAIRIE ISLAND-1	PWR	W (2-loop) DRY	1650	566	521	NSP	WH	1968-6	1973-12	1973-12	90.4	90.4	-
	US-306	PRAIRIE ISLAND-2	PWR	W (2-loop) DRY	1650	640	519	NSP	WH	1969-6	1974-12	1974-12	93.9	93.9	-
	US-284	QUAD CITIES-1	BWR	BWR-3 (Mark 1)	2957	913	882	EXELON	GE	1967-2	1972-4	1973-2	94.6	94.6	-
	US-285	QUAD CITIES-2	BWR	BWR-3 (Mark 1)	2511	908	892	EXELON	GE	1967-2	1972-5	1973-3	95.7	95.7	-
	US-244	R.E. GINNA	BWR	W (2-loop)	1775	608	580	CONSTELL	WH	1966-4	1969-12	1970-7	94.5	94.5	-
	US-458	RIVER BEND-1	BWR	BWR-6 (Mark 3)	3091	1036	967	ENTERGY	GE	1977-3	1985-12	1986-6	90.0	91.1	-
	US-272	SALEM-1	PWR	W (4-loop) DRY	3459	1228	1174	PSEG	WH	1968-9	1976-12	1977-6	92.0	92.3	-
	US-311	SALEM-2	PWR	W (4-loop) DRY	3459	1170	1158	PSEG	WH	1968-9	1981-6	1981-10	92.0	92.0	-
	US-361	SAN ONOFRE-2	PWR	CE (2-loop) DR	3438	1127	1070	SCE	CE	1974-3	1982-9	1983-8	81.9	82.0	-
	US-362	SAN ONOFRE-3	PWR	CE (2-loop) DR	3438	1127	1080	SCE	CE	1974-3	1983-9	1984-4	85.1	85.3	-
	US-443	SEABROOK-1	PWR	W (4-loop) DRY	3587	1296	1247	NEXTERA	WH	1976-7	1990-5	1990-8	89.7	89.7	-
	US-327	SEQUOYAH-1	PWR	W (4-loop) ICE	3411	1221	1152	TVA	WH	1970-5	1980-7	1981-7	92.2	92.2	-
	US-328	SEQUOYAH-2	PWR	W (4-loop) IC	3411	1221	1126	TVA	WH	1970-5	1981-12	1982-6	93.3	93.3	-
	US-400	SHEARON HARRIS-1	PWR	W (3-loop) DRY	2900	960	900	PROGRESS	WH	1978-1	1987-1	1987-5	94.3	94.3	-
	US-488	SOUTH TEXAS-1	PWR	W (4-loop)	3853	1354	1280	STP	WH	1975-12	1988-3	1988-8	93.5	93.5	-
	US-499	SOUTH TEXAS-2	PWR	W (4-loop) DRY	3853	1354	1280	STP	WH	1975-12	1989-4	1989-6	89.6	89.6	-
	US-335	ST. LUCIE-1	PWR	COMB CE DRY	2700	883	839	FPL	CE	1976-5	1976-5	1976-12	88.0	88.0	-
	US-389	ST. LUCIE-2	PWR	COMB CE DRY	2700	883	839	FPL	CE	1977-6	1983-6	1983-8	81.2	81.2	-
	US-280	SURRY-1	PWR	W (3-loop) DRY	2546	848	839	DOMINION	WH	1968-6	1972-7	1972-12	93.2	93.6	-
	US-281	SURRY-2	PWR	W (3-loop) DRY	2546	848	839	DOMINION	WH	1968-6	1973-3	1973-5	92.3	92.3	-
	US-387	SUSQUEHANNA-1	BWR	BWR-4 (Mark 2)	3952	1298	1260	PPL SUSQ	GE	1973-11	1982-11	1983-6	89.9	89.9	-
	US-388	SUSQUEHANNA-2	BWR	BWR-4 (Mark 2)	3489	1300	1260	PPL SUSQ	GE	1973-11	1984-7	1985-2	90.3	90.3	-
	US-289	THREE MILE ISLAND-1	PWR	B&W (L-loop)	2568	837	805	EXELON	B&W	1968-5	1974-6	1974-9	91.4	91.4	-
	US-250	TURKEY POINT-3	PWR	W (3-loop) DRY	2300	729	693	FPL	WH	1967-4	1972-11	1972-12	89.6	90.0	-

TABLE 14. REACTORS IN OPERATION, 31 DEC. 2011 — continued

Country	Reactor		Type	Model	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	EAF % 2007–2011	UCF % 2007–2011	Non-electrical applies
	Code	Name			Thermal	Gross								
	US-251	TURKEY POINT-4	PWR	W (3-loop) DRY	2300	729	693	FPL	1967-4	1973-6	1973-9	89.9	90.0	-
	US-271	VERMONT YANKEE	BWR	BWR-4 (Mark 1)	1912	650	620	ENERGY	1967-12	1972-9	1972-11	94.1	94.1	-
	US-395	VIRGIL C. SUMMER-1	PWR	W (3-loop) DRY	2900	1003	966	SC&G	1973-3	1982-11	1984-1	90.3	90.3	-
	US-424	VOGTLE-1	PWR	W (4-loop) DRY	3565	1203	1150	SOUTHERN	1976-8	1987-3	1987-6	94.0	94.0	-
	US-425	VOGTLE-2	PWR	W (4-loop) DRY	3565	1202	1152	SOUTHERN	1976-8	1989-4	1989-5	91.2	91.2	-
	US-382	WATERFORD-3	PWR	CE (2-loop)	3716	1200	1168	ENERGY	1974-11	1985-3	1985-9	92.3	92.8	-
	US-390	WATTS BAR-1	PWR	W (4-loop) (IC)	3459	1202	1123	TVA	1973-1	1996-2	1996-5	91.3	91.3	-
	US-482	WOLF CREEK	PWR	W (4-loop)	3565	1213	1195	WGNOC	1977-5	1985-6	1985-9	86.9	86.9	-
	TW-1	CHIN SHAN-1	BWR	BWR-4	1804	636	604	TPC	1972-6	1977-11	1978-12	87.0	87.2	-
	TW-2	CHIN SHAN-2	BWR	BWR-4	1804	636	604	TPC	1973-12	1978-12	1979-7	90.6	90.9	-
	TW-3	KUOSHENG-1	BWR	BWR-6	2943	1019	985	TPC	1975-11	1981-5	1981-12	91.6	92.4	-
	TW-4	KUOSHENG-2	BWR	BWR-6	2943	1020	985	TPC	1976-3	1982-6	1983-3	88.8	90.3	-
	TW-5	MAANSHAN-1	PWR	WE 312 (3 loop)	2822	956	918	TPC	1978-8	1984-5	1984-7	94.3	94.4	-
	TW-6	MAANSHAN-2	PWR	WE 312 (3 loop)	2822	958	922	TPC	1979-2	1985-2	1985-5	93.3	93.3	-

Note: Status as of 31 December 2011, 435 reactors (368791 MW) were connected to the grid, including 6 units (5018 MW) in Taiwan, China:

TAIWAN, CN	TW-1	CHIN SHAN-1	BWR	BWR-4	1804	636	604	TPC	1972-6	1977-11	1978-12	87.0	87.2	-
TAIWAN, CN	TW-2	CHIN SHAN-2	BWR	BWR-4	1804	636	604	TPC	1973-12	1978-12	1979-7	90.6	90.9	-
TAIWAN, CN	TW-3	KUOSHENG-1	BWR	BWR-6	2943	1019	985	TPC	1975-11	1981-5	1981-12	91.6	92.4	-
TAIWAN, CN	TW-4	KUOSHENG-2	BWR	BWR-6	2943	1020	985	TPC	1976-3	1982-6	1983-3	88.8	90.3	-
TAIWAN, CN	TW-5	MAANSHAN-1	PWR	WE 312 (3 loop)	2822	956	918	TPC	1978-8	1984-5	1984-7	94.3	94.4	-
TAIWAN, CN	TW-6	MAANSHAN-2	PWR	WE 312 (3 loop)	2822	958	922	TPC	1979-2	1985-2	1985-5	93.3	93.3	-

TABLE 15. REACTORS IN LONG TERM SHUTDOWN, 31 DEC. 2011

Country	Reactor		Type	Model	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Long term shutdown date
	Code	Name			Thermal	Gross	Net						
CANADA	CA-8	BRUCE-1	PHWR	CANDU 791	2832	824	848	BRUCEPOW	OH/AECL	1971-6	1977-1	1977-9	1997-10
	CA-9	BRUCE-2	PHWR	CANDU 791	2832	824	848	BRUCEPOW	OH/AECL	1970-12	1976-9	1977-9	1995-10
	CA-5	PICKERING-2	PHWR	CANDU 500A	1744	542	515	OPG	OH/AECL	1966-9	1971-10	1971-12	1997-12
	CA-6	PICKERING-3	PHWR	CANDU 500A	1744	542	515	OPG	OH/AECL	1967-12	1972-5	1972-6	1997-12
JAPAN	JP-31	MONJU	FBR	-	714	280	246	JAEA	T/H/F/M	1986-5	1995-8	—	1995-12

Note: Status as of 31 December 2011, 5 reactors (2972 MW) were in long term shutdown.

TABLE 16. REACTORS PERMANENTLY SHUTDOWN, 31 DEC. 2011

Country	Reactor		Type	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Shut down	
	Code	Name		Thermal	Gross	Net							
ARMENIA	AM-18	ARMENIA-1	PWR	1375	408	376	ANPPJSC	FAEA	1969-7	1976-12	1977-10	1989-2	
BELGIUM	BE-1	BR-3	PWR	41	12	10	CEN/SCK	WH	1957-11	1962-10	1962-10	1987-6	
BULGARIA	BG-1	KOZLODUY-1	PWR	1375	440	408	KOZNP	AEE	1970-4	1974-7	1974-10	2002-12	
	BG-2	KOZLODUY-2	PWR	1375	440	408	KOZNP	AEE	1970-4	1975-8	1975-11	2002-12	
	BG-3	KOZLODUY-3	PWR	1375	440	408	KOZNP	AEE	1973-10	1980-12	1981-1	2006-12	
	BG-4	KOZLODUY-4	PWR	1375	440	408	KOZNP	AEE	1973-10	1982-5	1982-6	2006-12	
CANADA	CA-2	DOUGLAS POINT	PHWR	704	218	206	OH	AECL	1960-2	1967-1	1968-9	1984-5	
	CA-3	GENTILLY-1	HWWLR	792	266	250	HQ	AECL	1966-9	1971-4	1972-5	1977-6	
	CA-1	ROLPHTON NPD	PHWR	92	25	22	OH	CGE	1958-1	1962-6	1962-10	1987-8	
FRANCE	FR-9	BUGEY-1	GCR	1954	555	540	EDF	FRAM	1965-12	1972-4	1972-7	1994-5	
	FR-2	CHINON-A1	GCR	300	80	70	EDF	LEVIVIER	1957-2	1963-6	1964-2	1973-4	
	FR-3	CHINON-A2	GCR	800	230	180	EDF	LEVIVIER	1959-8	1965-2	1965-2	1985-6	
	FR-4	CHINON-A3	GCR	1170	480	360	EDF	GTM	1961-3	1966-8	1966-8	1990-6	
	FR-5	CHOOZ-A (ARDENNES)	PWR	1040	320	305	SENA	AFW	1962-1	1967-4	1967-4	1991-10	
	FR-6	EL-4 (MONT'S D'ARREE)	HWGCR	250	75	70	EDF	GAAA	1962-7	1967-7	1968-6	1985-7	
	FR-1B	G-2 (MARCOULE)	GCR	260	43	39	COGEMA	SACM	1955-3	1959-4	1959-4	1980-2	
	FR-1	G-3 (MARCOULE)	GCR	260	43	40	COGEMA	SACM	1956-3	1960-4	1960-4	1984-6	
	FR-10	PHENIX	FBR	345	142	130	CEA/EDF	CNCLNEY	1968-11	1973-12	1974-7	2010-2	
	FR-7	ST. LAURENT-A1	GCR	1650	500	390	EDF	FRAM	1963-10	1969-6	1969-6	1990-4	
	FR-8	ST. LAURENT-A2	GCR	1475	530	465	EDF	FRAM	1966-1	1971-8	1971-11	1992-5	
	FR-24	SUPER-PHENIX	FBR	3000	1242	1200	EDF	ASPALDO	1976-12	1986-1	1986-12	1998-12	
	GERMANY	DE-4	AVR JUELICH (AVR)	HTGR	46	15	13	AVR	BBK	1961-8	1967-12	1969-5	1988-12
		DE-12	BIBLIS-A (KWB A)	PWR	3517	1225	1167	RWE	KWU	1970-1	1974-8	1975-2	2011-8
DE-18		BIBLIS-B (KWB B)	PWR	3733	1300	1240	RWE	KWU	1972-4	1976-4	1977-2	2011-8	
DE-13		BRUNSBUTTEL (KKB)	BWR	2292	806	771	KKB	KWU	1970-4	1976-7	1977-2	2011-8	
DE-502		GREIFSWALD-1 (KGR 1)	PWR	1375	440	408	EWN	AEE	1970-3	1973-12	1974-7	1990-2	

TABLE 16. REACTORS PERMANENTLY SHUTDOWN, 31 DEC. 2011 — continued

Country	Reactor		Type	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Shut down
	Code	Name		Thermal	Gross						
GERMANY	DE -503	GREIFSWALD-2 (KGR 2)	PWR	1375	440	408	AIEE	1970-3	1974-12	1975-4	1990-2
	DE -504	GREIFSWALD-3 (KGR 3)	PWR	1375	440	408	AIEE	1972-4	1977-10	1978-5	1990-2
	DE -505	GREIFSWALD-4 (KGR 4)	PWR	1375	440	408	AIEE	1972-4	1979-9	1979-11	1990-7
	DE -506	GREIFSWALD-5 (KGR 5)	PWR	1375	440	408	AIEE	1976-12	1989-4	1989-11	1999-11
	DE -3	GUNDREMMINGEN-A (KRB A)	BWR	801	250	237	AEG, GE	1962-12	1966-12	1967-4	1977-1
	DE -7	HDR GROSSWELZHEIM	BWR	100	25	25	HDR, KWU	1965-1	1969-10	1970-8	1971-4
	DE -16	ISAR-1 (KKI 1)	BWR	2575	912	878	E.ON	1972-5	1977-12	1979-3	2011-8
	DE -8	KNK II	FR	58	21	17	KBG	1974-9	1978-4	1979-3	1991-8
	DE -20	KRUEMMEL (KKK)	BWR	3690	1402	1346	KKK	1974-4	1983-9	1984-3	2011-8
	DE -6	LINGEN (KWL)	BWR	520	268	183	KWL	1964-10	1968-7	1968-10	1979-1
	DE -22	MUELHEIM-KAERLICH (KMK)	BWR	3760	1302	1219	KBG	1975-1	1986-3	1987-8	1988-9
	DE -2	MZFR	PHWR	200	57	52	KBG	1961-12	1966-3	1966-12	1984-5
	DE -15	NECKARWESTHEIM-1 (GKN 1)	PWR	2497	840	785	EnKK	1972-2	1978-6	1976-12	2011-8
	DE -11	NIEDERAICHBACH (KKN)	HWGCR	321	106	100	KKN	1966-6	1973-1	1973-1	1974-7
	DE -5	OBRIEGHEIM (KWO)	PWR	1050	357	340	EnBW	1965-3	1968-10	1969-3	2005-5
	DE -14	PHILIPPSBURG-1 (KKP 1)	BWR	2575	926	890	EnKK	1970-10	1979-5	1980-3	2011-8
	DE -501	PHILIPPSBURG-2 (KKP 2)	BWR	265	70	62	E.ON	1960-1	1966-5	1966-10	1990-6
	DE -10	STADE (KKS)	PWR	1900	672	640	E.ON	1967-12	1972-1	1972-5	2003-11
	DE -19	THTR-300	HTGR	750	308	296	HKG	1971-5	1985-11	1987-6	1988-4
DE -17	UNTERWESER (KKU)	PWR	3900	1410	1345	E.ON	1972-7	1978-9	1979-9	2011-8	
DE -1	VAK KAHL	BWR	60	16	15	VAK	1958-7	1961-6	1962-2	1985-11	
DE -9	WUERGASSEN (KWW)	BWR	1912	670	640	PE	1968-1	1971-12	1975-11	1994-8	
ITALY	IT -4	CAORSO	BWR	2651	882	860	SOGIN	1961-1	1978-5	1981-12	1990-7
	IT -3	ENRICO FERMI (TRINO)	PWR	870	270	260	AL/WEST	1961-7	1964-10	1965-1	1990-7
	IT -2	GARIGLIANO	BWR	506	160	150	SOGIN	1959-11	1964-1	1964-6	1982-3
	IT -1	LATINA	GCR	660	160	153	SOGIN	1958-11	1963-5	1964-1	1987-12
JAPAN	JP -20	FUGEN ATR	HWLRW	557	165	148	JAEA	1972-5	1978-7	1979-3	2003-3
	JP -5	FUKUSHIMA-DAIICHI-1	BWR	1380	460	439	TEPCO	1967-7	1970-11	1971-3	2011-5
	JP -9	FUKUSHIMA-DAIICHI-2	BWR	2381	784	760	TEPCO	1969-6	1973-12	1974-7	2011-5
	JP -10	FUKUSHIMA-DAIICHI-3	BWR	2381	784	760	TEPCO	1970-12	1974-10	1976-3	2011-5

TABLE 16. REACTORS PERMANENTLY SHUTDOWN, 31 DEC. 2011 — continued

Country	Reactor		Type	Capacity (MW)			Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Shut down
	Code	Name		Thermal	Gross	Net						
JAPAN	JP-16	FUKUSHIMA-DAICHI-4	BWR	2381	784	760	TEPCO	HITACHI	1973-2	1978-2	1978-10	2011-5
	JP-11	HAMAOKA-1	BWR	1593	540	515	CHUBU	TOSHIBA	1971-6	1974-8	1976-3	2009-1
	JP-24	HAMAOKA-2	BWR	2436	840	806	CHUBU	TOSHIBA	1974-6	1978-5	1978-11	2009-1
	JP-1	JPDR	BWR	90	13	12	JAEA	GE	1960-12	1963-10	1965-3	1976-3
	JP-2	TOKAI-1	GCR	587	166	137	JAPCO	GEC	1961-3	1965-11	1966-7	1998-3
KAZAKHSTAN	KZ-10	BN-350	FBR	1000	90	52	MAEC-KAZ	MAEC-KAZ	1964-10	1973-7	1973-7	1999-4
LITHUANIA	LT-46	IGNALINA-1	LWGR	4800	1300	1185	INPP	MAEP	1977-5	1983-12	1984-5	2004-12
	LT-47	IGNALINA-2	LWGR	4800	1300	1185	INPP	MAEP	1978-1	1987-8	1987-8	2009-12
NETHERLANDS	NL-1	DODEWAARD	BWR	183	60	55	BV GKN	RDM	1965-5	1968-10	1969-3	1997-3
RUSSIA	RU-1	APS-1 OBNINSK	LWGR	30	6	5	REA	MSM	1951-1	1954-6	1954-12	2002-4
	RU-3	BELOYARSKY-1	LWGR	286	108	102	REA	MSM	1958-6	1964-4	1964-4	1983-1
	RU-6	BELOYARSKY-2	LWGR	530	160	146	REA	MSM	1962-1	1967-12	1969-12	1990-1
	RU-4	NOVOVORONEZH-1	PWR	760	210	197	REA	MSM	1957-7	1964-9	1964-12	1988-2
	RU-8	NOVOVORONEZH-2	PWR	1320	365	336	REA	MSM	1964-6	1969-12	1970-4	1990-8
SLOVAKIA	SK-1	BOHUNICE A1	HWGCR	560	143	93	JAVYS	SKODA	1958-8	1972-12	1972-12	1977-2
	SK-2	BOHUNICE-1	PWR	1375	440	408	JAVYS	AEE	1972-4	1978-12	1980-4	2006-12
	SK-3	BOHUNICE-2	PWR	1375	440	408	JAVYS	AEE	1972-4	1980-3	1981-1	2008-12
SPAIN	ES-1	JOSE CABRERA-1 (ZORITA)	PWR	510	150	141	UFG	WH	1964-6	1968-7	1969-8	2006-4
	ES-3	VANDELLOS-1	GCR	1670	500	480	HIFRENSA	CEA	1968-6	1972-5	1972-8	1990-7
SWEDEN	SE-1	AGESTA	PHWR	80	12	10	BKAB	ABBATOM	1957-12	1964-5	1964-5	1974-6
	SE-6	BARSEBACK-1	BWR	1800	615	600	BKAB	ASEASTAL	1971-2	1975-5	1975-7	1999-11
	SE-8	BARSEBACK-2	BWR	1800	615	600	BKAB	ABBATOM	1973-1	1977-3	1977-7	2005-5
	CH-8	LUCENS	HWGCR	28	6	6	EOS	NGA	1962-4	1968-1	NA	1969-1
UK	GB-3A	BERKELEY 1	GCR	620	166	138	MEL	TNPG	1957-1	1962-6	1962-6	1989-3

TABLE 16. REACTORS PERMANENTLY SHUTDOWN, 31 DEC. 2011 — continued

Country	Reactor		Type	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Shut down
	Code	Name		Thermal	Gross						
UK	GB-3B	BERKELEY 2	GCR	620	166	MEL	TNPG	1957-1	1962-6	1962-10	1988-10
	GB-4A	BRADWELL 1	GCR	481	146	MEL	TNPG	1957-1	1962-7	1962-7	2002-3
	GB-4B	BRADWELL 2	GCR	481	146	MEL	TNPG	1957-1	1962-7	1962-11	2002-3
	GB-1A	CALDER HALL 1	GCR	268	60	MEL	UKAEA	1953-8	1956-8	1956-10	2003-3
	GB-1B	CALDER HALL 2	GCR	268	60	MEL	UKAEA	1953-8	1957-2	1957-2	2003-3
	GB-1C	CALDER HALL 3	GCR	268	60	MEL	UKAEA	1955-8	1958-3	1958-5	2003-3
	GB-1D	CALDER HALL 4	GCR	268	60	MEL	UKAEA	1955-8	1959-4	1959-4	2003-3
	GB-2A	CHAPELCROSS 1	GCR	260	60	MEL	UKAEA	1955-10	1959-7	1959-8	2004-6
	GB-2B	CHAPELCROSS 2	GCR	260	60	MEL	UKAEA	1955-10	1959-11	1959-12	2004-6
	GB-2C	CHAPELCROSS 3	GCR	260	60	MEL	UKAEA	1955-10	1960-3	1960-3	2004-6
	GB-2D	CHAPELCROSS 4	GCR	260	60	MEL	UKAEA	1955-3	1962-10	1962-10	1977-3
	GB-14	DOUNREAY DFR	FBR	60	15	UKAEA	TNPG	1966-1	1975-1	1976-7	1994-3
	GB-15	DOUNREAY PFR	FBR	600	250	234	TNPG	1966-1	1965-9	1965-10	2006-12
	GB-9A	DUNGENESS-A1	GCR	840	230	225	MEL	TNPG	1960-7	1965-11	2006-12
	GB-9B	DUNGENESS-A2	GCR	840	230	225	MEL	TNPG	1960-7	1965-11	2006-12
	GB-7A	HINKLEY POINT-A1	GCR	900	267	235	MEL	EE/B&W/T	1957-11	1965-2	2000-5
	GB-7B	HINKLEY POINT-A2	GCR	900	267	235	MEL	EE/B&W/T	1957-11	1965-2	2000-5
GB-6A	HUNTERSTON-A1	GCR	595	173	150	MEL	GEC	1957-10	1964-2	1990-3	
GB-6B	HUNTERSTON-A2	GCR	595	173	150	MEL	GEC	1957-10	1964-2	1989-12	
GB-11B	OLDBURY-A2	GCR	660	230	217	MEL	TNPG	1962-5	1968-9	2011-6	
GB-10A	SIZEWELL-A1	GCR	1010	245	210	MEL	EE/B&W/T	1961-4	1966-1	2006-12	
GB-10B	SIZEWELL-A2	GCR	1010	245	210	MEL	EE/B&W/T	1961-4	1966-9	2006-12	
GB-8A	TRAWSFYNYDD 1	GCR	850	235	195	MEL	APC	1959-7	1965-1	1991-2	
GB-8B	TRAWSFYNYDD 2	GCR	850	235	195	MEL	APC	1959-7	1965-3	1991-2	
GB-5	WINDSCALE AGR	GCR	120	36	24	UKAEA	UKAEA	1958-11	1963-2	1981-4	
GB-12	WINFRITH SGHWR	SGHWR	318	100	92	UKAEA	ICL/FE	1963-5	1967-12	1990-9	
UKRAINE	UA-25	CHERNOBYL-1	LWGR	3200	800	MTE	FAEA	1970-3	1977-9	1978-5	1986-11
	UA-26	CHERNOBYL-2	LWGR	3200	1000	MTE	FAEA	1973-2	1978-12	1979-5	1991-10
	UA-42	CHERNOBYL-3	LWGR	3200	1000	MTE	FAEA	1976-3	1981-12	1982-6	2000-12
	UA-43	CHERNOBYL-4	LWGR	3200	1000	MTE	FAEA	1979-4	1983-12	1984-3	1986-4
USA	US-155	BIG ROCK POINT	BWR	240	71	CPC	GE	1960-5	1962-12	1963-3	1997-8

TABLE 16. REACTORS PERMANENTLY SHUTDOWN, 31 DEC. 2011 — continued

Country	Reactor		Type	Capacity (MW)		Operator	NSSS supplier	Construction start	Grid connection	Commercial operation	Shut down	
	Code	Name		Thermal	Gross							Net
USA	US-014	BONUS	BWR	50	18	DOE/PRWR	GNEPRWRA	1960-1	1964-8	1965-9	1968-6	
	US-144	CVTR	PHWR	65	19	CVPA	WH	1960-1	1963-12	NA	1967-1	
	US-10	DRESDEN-1	BWR	700	207	EXELON	GE	1956-5	1960-4	1960-7	1978-10	
	US-011	ELK RIVER	BWR	58	24	RCPA	AC	1959-1	1963-8	1964-7	1968-2	
	US-16	ENRICO FERMI-1	FBR	200	65	DTEDISON	UEC	1956-8	1966-8	NA	1972-11	
	US-267	FORT ST. VRAIN	HTGR	842	342	PSCC	GA	1968-9	1976-12	1979-7	1989-8	
	US-018	GE VALLECITOS	BWR	50	24	GE	GE	1956-1	1957-10	1957-10	1963-12	
	US-213	HADDAM NECK	PWR	1825	603	CYAPC	WH	1964-5	1967-8	1968-1	1996-12	
	US-077	HALLAM	X	256	84	AEC/NPPD	GE	1959-1	1963-9	1963-11	1964-9	
	US-133	HUMBOLDT BAY	BWR	220	65	PG&E	GE	1960-11	1963-4	1963-8	1976-7	
	US-013	INDIAN POINT-1	PWR	615	277	ENERGY	B&W	1956-5	1962-9	1962-10	1974-10	
	US-409	LACROSSE	BWR	165	55	DPC	AC	1963-3	1968-4	1969-11	1987-4	
	US-309	MAINE YANKEE	PWR	2630	900	MYAPC	CE	1968-10	1972-11	1972-12	1997-8	
	US-245	MILLSTONE-1	BWR	2011	684	641	DOMINION	GE	1966-5	1970-11	1971-3	1999-7
	US-130	PATHFINDER	BWR	220	63	59	NMC	AC	1959-1	1966-7	NA	1967-10
	US-171	PEACH BOTTOM-1	HTGR	115	42	40	EXELON	GA	1962-2	1967-1	1967-6	1974-11
	US-012	PIQUA	X	46	12	12	CoPhiqua	GE	1960-1	1963-7	1963-11	1966-1
	US-312	RANCHO SECO-1	PWR	2772	917	873	SMUD	B&W	1969-4	1974-10	1975-4	1989-6
	US-206	SAN ONOFRE-1	PWR	1347	456	436	SCE	WH	1964-5	1967-7	1968-1	1992-11
	US-146	SAXTON	PWR	24	3	3	SNEC	GE	1960-1	1967-3	1967-3	1972-5
	US-001	SHIPPINGPORT	PWR	236	68	60	DOE DUQU	WH	1954-1	1957-12	1958-5	1982-10
	US-322	SHOREHAM	BWR	2436	849	820	LIPA	GE	1972-11	1986-8	NA	1989-5
	US-320	THREE MILE ISLAND-2	PWR	2772	959	880	GPU	B&W	1969-11	1978-4	1978-12	1979-3
	US-344	TROJAN	PWR	3411	1155	1095	PORTGE	WH	1970-2	1975-12	1976-5	1992-11
	US-29	YANKEE NPS	PWR	600	180	167	YAEC	WH	1957-11	1960-11	1961-7	1991-10
	US-295	ZION-1	PWR	3250	1085	1040	EXELON	WH	1968-12	1973-6	1973-12	1998-2
	US-304	ZION-2	PWR	3250	1085	1040	EXELON	WH	1968-12	1973-12	1974-9	1998-2

Note: Status as of 31 December 2011. 138 reactors (49152 MW) have been permanently shut down.

TABLE 17. REACTORS IN DECOMMISSIONING PROCESS OR DECOMMISSIONED, 31 Dec. 2011

Country	Reactor		Shut down	Shutdown reason	Decom. strategy	Current decom. phase	Current fuel management phase	Decom. licensee	Licence terminated
	Code	Name							
ARMENIA	AM-18	ARMENIA-1	1989-2	Other	Other			ANPPJSC	
BELGIUM	BE-1	BR-3	1987-6	2,5	Imdte.dism.	4,9	4	CEN/SCK	
BULGARIA	BG-1	KOZLODUY-1	2002-12	7,Other	Dd+PD+SE	6,7	3,6,7	E-03492	2036
	BG-2	KOZLODUY-2	2002-12	7,Other	Dd+PD+SE	6,7	3,6,7	E-03493	2036
	BG-3	KOZLODUY-3	2006-12	7,Other	Dd+PD+SE	7	2,6,7	E-00174	2036
	BG-4	KOZLODUY-4	2006-12	7,Other	Dd+PD+SE	7	2,7	E-0008	2036
CANADA	CA-1	ROLPHTON NPD	1987-8	2	Dd+PD+SE	8		AECL	
	CA-2	DOUGLAS POINT	1984-5	2	Dd+SE	8	7	AECL	
	CA-3	GENTILLY-1	1977-6	2	Dd+PD+SE	8	7	AECL	
FRANCE	FR-10	PHENIX	2010-2	Other	Imdte.dism.	8		-	
	FR-2	CHINON-A1	1973-4	1,2	Imdte.dism.				
	FR-24	SUPER-PHENIX	1998-12	Other	Imdte.dism.	6		NERSA	2025
	FR-3	CHINON-A2	1985-6	1,2	Imdte.dism.		3,6	EDF	
	FR-4	CHINON-A3	1990-6	1,2	Imdte.dism.			EDF	
	FR-5	CHOOZA (ARDENNES)	1991-10	Other	Imdte.dism.	4,9		SENA	2019
	FR-6	EL-4 (MONT'S D'ARREE)	1985-7	1,2	Imdte.dism.	9		EDF	2015
	FR-7	ST. LAURENT-A1	1990-4	1,2	Imdte.dism.			EDF	2027
	FR-8	ST. LAURENT-A2	1992-5	1,2	Imdte.dism.			EDF	2025
	FR-9	BUGEY-1	1994-5	1,2	Imdte.dism.	9		EDF	2020
GERMANY	DE-10	STADE (KKS)	2003-11	2	Imdte.dism.	3,4,6		E.ON	2014
	DE-3	GUNDREMMINGEN-A (KRB A)	1977-1	6,8	Imdte.dism.			KGG	
	DE-4	AVR JUELICH (AVR)	1988-12	7	Imdte.dism.	3,4,9		xxxx	
	DE-501	RHEINBERG (KKR)	1990-6	1	Imdte.dism.		4	G01 KKR	
	DE-502	GREIFSWALD-1 (KGR 1)	1990-2	3,6,7	Imdte.dism.	3,9	4	G01	
	DE-503	GREIFSWALD-2 (KGR 2)	1990-2	3,6,7	Imdte.dism.	3	4	G01	
	DE-504	GREIFSWALD-3 (KGR 3)	1990-2	3,6	Imdte.dism.	3	3	G01	
	DE-505	GREIFSWALD-4 (KGR 4)	1990-7	3,5,7	Imdte.dism.	3	3	G01	
	DE-506	GREIFSWALD-5 (KGR 5)	1989-11	3,6,7	Imdte.dism.	1,3	3	G01	
	DE-6	LINGEN (KWL)	1979-1	2	Dd+PD+SE	8		KWL GmbH	2014
	DE-9	WUERGASSEN (KWW)	1994-8	2	Imdte.dism.	3,4,6		E.ON	2018
ITALY	IT-1	LATINA	1987-12	7,Other	Imdte.dism.	3,4,9		SOGIN	

TABLE 17. REACTORS IN DECOMMISSIONING PROCESS OR DECOMMISSIONED, 31 Dec. 2011 — continued

Country	Reactor		Shut down	Shutdown reason	Decom. strategy	Current decom. phase	Current fuel management phase	Decom. licensee	Licence terminated
	Code	Name							
ITALY	IT-2	GARIGLIANO	1982-3	3,4 Other	Imdte. dism.	3,4		SOGIN	2019
	IT-3	ENRICO FERMI (TRINO)	1990-7	7, Other	Imdte. dism.	3,4,9	3,5	SOGIN	2013
	IT-4	CAORSO	1990-7	7, Other	Imdte. dism.	3,4		SOGIN	2019
	JP-1	JPDR	1976-3	Other	Imdte. dism.	3		JAERI	2002
JAPAN	JP-11	HAMAOKA-1	2009-1	6	Dd+SE	1,6,7	2	CHUBU DL	2037
	JP-2	TOKAI-1	1998-3	2	Dd+PD+SE	3,4,6,7,9		JAPCO	2018
	JP-20	FUGEN ATR	2003-3	2	Dd+SE	1,3,5	2,5	JAEA	2029
	JP-24	HAMAOKA-2	2009-1	6	Dd+SE	1,6,7	2	CHUBU DL	2037
KAZAKHSTAN	KZ-10	BN-350	1999-4	2,5	Dd+PD+SE	1,5,6	2,4,7	MAEC-KAZ	2030
	LT-46	IGNALINA-1	2004-12	7, Other	Imdte. dism.	3		INPP	2030
	LT-47	IGNALINA-2	2009-12	7, Other	Imdte. dism.	2,3	1	INPP	2030
	NL-1	DODEWAARD	1997-3	2, Other	Dd+SE	7		BV GKN	2055
NETHERLANDS	RU-3	BELOYARSKY-1	1983-1	Other	Other			EA	
	RU-4	NOVOORONEZH-1	1988-2	Other	Other			EA	
	RU-6	BELOYARSKY-2	1990-1	Other	Other			EA	
	RU-8	NOVOORONEZH-2	1990-8	Other	Other			EA	
RUSSIA	SK-1	BOHUNICE A1	1977-2	4	Dd+PD+SE	3,6		JAVYS	
	SK-2	BOHUNICE-1	2006-12	7	Imdte. dism.	3,4,9	3,6	JAVYS	
	SK-3	BOHUNICE-2	2008-12	7	Imdte. dism.	3,4,9	2,3,6	JAVYS	
	ES-1	JOSE CABRERA-1 (ZORITA)	2006-4	Other	Imdte. dism.	3,4,9	3,7	UFG	2015
SPAIN	ES-3	VANDELLOS-1	1990-7	4	Dd+PD+SE	8		ENRESA	2032
	SE-1	AGESTA	1974-6	2,3	Dd+SE	7		BKAB	2025
	SE-6	BARSEBACK-1	1999-11	Other	Other		4	BKAB	2025
	SE-8	BARSEBACK-2	2005-5	Other	Other		4	BKAB	2025
SWEDEN	CH-8	LUCENS	1969-1	4	Dd+SE	1		EOS	2004
	GB-10A	SIZEWELL-A1	2006-12	2,8	Dd+SE	2,3,5,6		Magnox S	2110
	GB-10B	SIZEWELL-A2	2006-12	2,8	Dd+SE	2,3,5,6		Magnox S	2110
	GB-12	WINFRITH SGHWR	1990-9	Other	Imdte. dism.	3,4,9,10		UKAEA	2019
SWITZERLAND	GB-14	DOUNREAY DFR	1977-3	Other	Dd+PD+SE	2,5	5	DSR	2333
	GB-15	DOUNREAY PFR	1994-3	Other	Dd+PD+SE	5		Magnox N	2333
	GB-1A	CALDER HALL 1	2003-3	2,8	Dd+PD+SE	3,5,6,8		SL	2117
	GB-1B	CALDER HALL 2	2003-3	2,8	Dd+PD+SE	3,5,6,8		SL	2117

TABLE 17. REACTORS IN DECOMMISSIONING PROCESS OR DECOMMISSIONED, 31 Dec. 2011 — continued

Country	Reactor		Shut down	Shutdown reason	Decom. strategy	Current decom. phase	Current fuel management phase	Decom. licensee	Licence terminated
	Code	Name							
UK	GB-1C	CALDER HALL 3	2003-3	2,8	Dd+PD+SE	3,5,6,8		SL	2117
	GB-1D	CALDER HALL 4	2003-3	2,8	Dd+PD+SE	3,5,6,8		SL	2117
	GB-2A	CHAPELCROSS 1	2004-6	2,8	Dd+PD+SE	3,5,6		Magnox N	2128
	GB-2B	CHAPELCROSS 2	2004-6	2,8	Dd+PD+SE	3,5,6		Magnox N	2128
	GB-2C	CHAPELCROSS 3	2004-6	2,8	Dd+PD+SE	3,5,6		Magnox N	2128
	GB-2D	CHAPELCROSS 4	2004-6	2,8	Dd+PD+SE	3,5,6		Magnox N	2128
	GB-3A	BERKELEY 1	1989-3	2,8	Dd+SE	3,8		Magnox S	2083
	GB-3B	BERKELEY 2	1988-10	2,8	Dd+SE	3,8		Magnox S	2083
	GB-4A	BRADWELL 1	2002-3	2,8	Dd+SE	3,5,6		Magnox S	2104
	GB-4B	BRADWELL 2	2002-3	2,8	Dd+SE	3,5,6		Magnox S	2104
	GB-5	WINDSCALE AGR	1981-4	Other	Dd+PD+SE	2,3,5,6		SL	2065
	GB-6A	HUNTERSTON-A1	1990-3	2,8	Dd+PD+SE	3,5,6		Magnox N	2090
	GB-6B	HUNTERSTON-A2	1989-12	2,8	Dd+PD+SE	3,5,6		Magnox N	2090
	GB-7A	HINKLEY POINT-A1	2000-5	2,8	Dd+PD+SE	3,5,6		Magnox S	2104
	GB-7B	HINKLEY POINT-A2	2000-5	2,8	Dd+PD+SE	3,5,6		Magnox S	2104
	GB-8A	TRAWSFYNDD 1	1991-2	2,8	Dd+PD+SE	3,5,6		Magnox N	2098
GB-8B	TRAWSFYNDD 2	1991-2	2,8	Dd+PD+SE	3,5,6		Magnox N	2098	
GB-9A	DUNGENESS-A1	2006-12	2,8	Dd+PD+SE	3,5,6		Magnox S	2111	
GB-9B	DUNGENESS-A2	2006-12	2,8	Dd+PD+SE	3,5,6		Magnox S	2111	
USA	US-001	SHIPPINGPORT	1982-10	3	lmdte.dism.	3,5,6		DOE DUQU	1989
	US-011	ELK RIVER	1968-2	1,Other	lmdte.dism.			RCPA	1974
	US-012	PIQUA	1966-1	4,5	in situ disp.	11		CofPiqua	
	US-013	INDIAN POINT-1	1974-10	5	Dd+PD+SE			ENERGY	
	US-014	BONUS	1968-6	5,6	in situ disp.				
	US-018	GE VALLECITOS	1963-12	1	Dd+SE			GE&PGEC	1970
	US-077	HALLAM	1964-9	5	Dd+SE			AEC&NPPD	1971
	US-10	DRESDEN-1	1978-10	6	Dd+SE	11	7	EXELON	
	US-130	PATHFINDER	1967-10	5	Dd+SE	11		NMC	
	US-133	HUMBOLDT BAY	1976-7	5	Dd+PD+SE	3,4,6,9		PG&E	2013
US-144	CVTR	1967-1	7,Other	Dd+SE			CVPA	2009	
US-146	SAXTON	1972-5	Other	lmdte.dism.			GPUNIC	2005	
US-155	BIG ROCK POINT	1997-8	2,Other	lmdte.dism.		7	CPC	2007	

TABLE 17. REACTORS IN DECOMMISSIONING PROCESS OR DECOMMISSIONED, 31 Dec. 2011 — continued

Country	Reactor		Shut down	Shutdown reason	Decom. strategy	Current decom. phase	Current fuel management phase	Decom. licensee	Licence terminated
	Code	Name							
USA	US -16	ENRICO FERMI-1	1972-11	4,5	Dd+SE	9,11		DTEDISON	2025
	US -171	PEACH BOTTOM-1	1974-11	1	Dd+SE	1		EXELON	
	US -206	SAN ONOFRE-1	1992-11	Other	Dd+PD+SE	4		SCE	2008
	US -213	HADDAM NECK	1996-12	6	lmdte.dism.	4,6		CYAPC	2007
	US -245	MILLSTONE-1	1998-7	6	Dd+PD+SE			DOMINRES	
	US -267	FORT ST. VRAIN	1989-8	1,Other	lmdte.dism.			PSCC	1996
	US -29	YANKEE NPS	1991-10	5,7	lmdte.dism.	4,6		YAEC	2005
	US -295	ZION-1	1998-2	5,6	Dd+PD+SE	1		CommonEd	
	US -304	ZION-2	1998-2	5,6	Dd+PD+SE	1		COMMED	
	US -309	MAINE YANKEE	1997-8	6	lmdte.dism.	4	7	MYAPC	2005
	US -312	RANCHO SECO-1	1989-6	5,6	Dd+PD+SE	9		SMUD	2009
	US -320	THREE MILE ISLAND-2	1979-3	4,5	Other	11	4	GPU	
	US -322	SHOREHAM	1989-5	7,Other	lmdte.dism.			LIPA	1995
	US -344	TROJAN	1992-11	6	Dd+PD+SE			PORTGE	2005
	US -409	LACROSSE	1987-4	2	Dd+PD+SE		7	DPC	

TABLE 17. DEFINITIONS FOR REACTORS IN DECOMMISSIONING PROCESS OR DECOMMISSIONED

Shutdown reason	Description	Decommissioning strategy	Description
1 2 3 4 5 6 7 undefd	The technology or process being used became obsolete The process was no longer profitable There were changes in licensing requirements After an operating incident Other technological reasons Other economical reasons Public acceptance reasons Other	Imdte dism. Dd+SE Dd+PD+SE in situ disp. undefined	Immediate dismantling and removal of all radioactive materials Deferred dismantling, placing all radiological areas into safe enclosure Deferred dismantling, including partial dismantling and placing remaining radiological areas into safe enclosure In situ disposal, involving encapsulation of radioactive materials and subsequent restriction of access Other
		Current decommissioning phase	Description
Fuel Management	Description		
1 2 3 4 5 6 7 8	Transfer to a reactor facility Transfer away from reactor facility Storage in an on-site facility Storage in an off-site facility Shipment to a reprocessing plant Underwater storage Dry storage Encapsulation	1 2 3 4 5 6 7 8 9 10 11	Drawing up the final decommissioning plan Reactor core defuelling Waste conditioning on-site (only for decommissioning waste) Waste shipment off-site (only for decommissioning waste) Safe enclosure preparation Partial dismantling Active safe enclosure period Passive safe enclosure period Final dismantling Final survey Licence terminated (legal act at the end of the decommissioning process)

TABLE 18. PERFORMANCE FACTORS BY REACTOR CATEGORY, 2009 to 2011

Reactor category	Reactors reporting to IAEA PRIS (see note)							
	Number of units	Availability factor (%)	Planned cap.loss factor (%)	Capacity factor (%)	Forced loss rate (%)	Operating factor (%)	Load factor (%)	
PWR	271	82.7	12.2	83.8	2.7	83.6	81.8	
PWR < 600 Mw(e)	47	83.2	15.1	83.5	1.3	83.8	82.0	
PWR >= 600 MW(e)	224	82.7	11.9	83.8	2.8	83.5	81.8	
BWR	94	73.0	18.9	74.5	5.9	73.7	71.8	
BWR < 600 MW(e)	12	64.7	22.9	67.4	10.7	68.1	64.6	
BWR >= 600 MW(e)	82	73.6	18.5	75.0	5.7	74.4	72.2	
PHWR	47	77.1	14.5	81.1	3.9	78.9	76.6	
PHWR < 600 MW(e)	26	65.9	15.0	77.2	7.9	76.0	64.9	
PHWR >= 600 MW(e)	21	82.5	14.2	83.0	2.0	82.4	82.2	
LWGR	16	79.6	16.9	79.9	2.7	76.8	80.0	
LWGR < 600 MW(e)	4	73.0	26.7	73.0	0.4	64.3	32.1	
LWGR >= 600 MW(e)	12	79.6	16.9	79.9	2.7	81.3	80.2	
GCR	18	68.1	11.7	68.3	14.6	76.0	68.2	
FBR	2	71.8	27.7	71.8	0.7	62.6	72.8	
TOTAL	448	79.7	14.0	81.2	3.7	80.4	78.9	

Note: 2011 is the latest year for which operating experience data is currently available to the IAEA.

— Reactors permanently shut down during 2009 to 2011 (17 units) are considered.

TABLE 19. FULL OUTAGE STATISTICS DURING 2011

Reactor Type	Number of units in the world	Full outage hours per operating experience year	Planned outages (%)	Unplanned outages (%)	External outages (%)
PWR	270	1520	82.7	15.4	1.9
PWR < 600 MW(e)	47	1669	93.3	5.1	1.6
PWR >= 600 MW(e)	223	1488	80.2	17.8	2.0
BWR	84	2684	76.5	10.0	13.5
BWR < 600 MW(e)	10	4028	69.3	19.7	11.0
BWR >= 600 MW(e)	74	2502	78.0	7.9	14.1
PHWR	47	1471	75.6	22.6	1.8
PHWR < 600 MW(e)	26	1590	65.9	31.3	2.8
PHWR >= 600 MW(e)	21	1323	90.0	9.6	0.4
LWGR	15	2065	72.0	4.1	23.9
LWGR < 600 MW(e)	4	3216	43.8	2.3	53.9
LWGR >= 600 MW(e)	11	1647	92.1	5.4	2.5
GCR	17	2000	47.7	51.3	1.0
FBR	2	809	100.0	0.0	0.0
ALL REACTORS	435	1773	78.3	15.6	6.1

Note: 2011 is the latest year for which outage information is currently available to the IAEA.

— Reactors shut down during 2011 (13 units) are considered.

TABLE 20. DIRECT CAUSES OF FULL OUTAGES DURING 2011

Direct outage cause	Planned full outages				Unplanned full outages			
	Energy lost		Time lost		Energy lost		Time lost	
	GW(e)·h	%	Hours	%	GW(e)·h	%	Hours	%
Plant equipment problem/failure					51296	89.30	65747	87.77
Refuelling without maintenance	28049	5.00	33796	5.07				
Inspection, maintenance or repair combined with refuelling	361161	64.34	415043	62.29				
Inspection, maintenance or repair without refuelling	33945	6.05	54034	8.11				
Testing of plant systems or components	1946	0.35	2935	0.44	578	1.01	983	1.31
Major back-fitting, refurbishment or upgrading activities with refuelling	9274	1.65	12964	1.95				
Major back-fitting, refurbishment or upgrading activities without refuelling	126119	22.47	138568	20.80				
Nuclear regulatory requirements					4251	7.40	5496	7.34
Human factor related					1042	1.81	2021	2.70
Fire	73	0.01	162	0.02	231	0.40	451	0.60
Fuel management limitation (including high flux tilt, stretch out or coast-down operation)	788	0.14	8760	1.31	41	0.07	208	0.28
Other								
TOTAL	561355	100.00	666262	100.00	57439	100.00	74906	100.00

Note: Only reactors which have achieved full commercial operation in or before 2011 are counted.

TABLE 21. DIRECT CAUSES OF FULL OUTAGES, 2007 TO 2011

Direct Outage Cause	Planned full outages				Unplanned full outages			
	Energy lost		Time lost		Energy lost		Time lost	
	GW(e)-h	%	Hours	%	GW(e)-h	%	Hours	%
Plant equipment problem/failure					367271	86.20	440342	85.74
Refuelling without maintenance	102376	4.13	117563	3.85				
Inspection, maintenance or repair combined with refuelling	1769760	71.31	2076012	68.06				
Inspection, maintenance or repair without refuelling	172346	6.94	288958	9.47				
Testing of plant systems or components	7199	0.29	17806	0.58	1284	0.30	3045	0.59
Major back-fitting, refurbishment or upgrading activities with refuelling	101883	4.10	153387	5.03				
Major back-fitting, refurbishment or upgrading activities without refuelling	323778	13.05	373676	12.25				
Nuclear regulatory requirements					44926	10.54	53351	10.39
Human factor related					6780	1.59	8817	1.72
Fire					3835	0.90	5277	1.03
External restrictions on supply and services	382	0.02	1909	0.06				
Fuel management limitation (including high flux tilt, stretch out or coast-down operation)	2725	0.11	3354	0.11	1204	0.28	1133	0.22
Other	1579	0.06	17522	0.57	793	0.19	1613	0.31
TOTAL	2481827	100.00	3050189	100.00	426091	100.00	513579	100.00

Note: Only reactors which have achieved full commercial operation in or before 2011 are counted.

TABLE 22. COUNTRIES: ABBREVIATIONS AND SUMMARY

Country Code	Full name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	LT shut down	Shut down	Planned
AM	ARMENIA	1			1	
AR	ARGENTINA	2	1			
BE	BELGIUM	7			1	
BG	BULGARIA	2	2		4	
BR	BRAZIL	2	1			
CA	CANADA	18		4	3	
CH	SWITZERLAND	5			1	
CN	CHINA	16	26			42
CZ	CZECH REPUBLIC	6				
DE	GERMANY	9			27	
ES	SPAIN	8			2	
FI	FINLAND	4	1			
FR	FRANCE	58	1		12	
GB	UNITED KINGDOM	18			27	
HU	HUNGARY	4				
IN	INDIA	20	7			
IR	IRAN, ISLAMIC REPUBLIC OF	1				3
IT	ITALY					
JP	JAPAN	50			4	
KR	KOREA, REPUBLIC OF	21		1	9	10
KZ	KAZAKHSTAN	2	5		2	
LT	LITHUANIA				1	2
MX	MEXICO	2				
NL	NETHERLANDS	1			1	
PK	PAKISTAN	3	2			
RO	ROMANIA	2				
RU	RUSSIAN FEDERATION	33	10		5	35
SE	SWEDEN	10			3	
SI	SLOVENIA	1				
SK	SLOVAKIA	4	2		3	

TABLE 22. COUNTRIES: ABBREVIATIONS AND SUMMARY — continued

Country Code	Full name	Number of reactors, as of 31 Dec. 2011					
		Operational	Construction	LT shut down	Shut down	Planned	
UA	UKRAINE	15	2		4		
US	UNITED STATES OF AMERICA	104	1		28	20	
VN	VIETNAM					2	
ZA	SOUTH AFRICA	2					
TOTAL		435	65	5	138	114	

Note: The total includes the following data from Taiwan, China:
 — 6 units in operation; 2 units under construction.

TABLE 23. REACTOR TYPES: ABBREVIATIONS AND SUMMARY

Type code	Full name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	LT shut down	Shut down	Planned
BWR	Boiling light water cooled and moderated reactor	84	4		31	10
FBR	Fast breeder reactor	2		1	7	2
GCR	Gas cooled, graphite moderated reactor	17	2		35	
HTGR	High temperature gas cooled, graphite moderated reactor				4	1
HWGCR	Heavy water moderated, gas cooled reactor				4	
HWLWR	Heavy water moderated, boiling light water cooled reactor				2	
LWGR	Light water cooled, graphite moderated reactor	15	1		9	
PHWR	Pressurized heavy water moderated and cooled reactor	47	5	4	5	
PWR	Pressurized light water moderated and cooled reactor	270	53		38	101
SGHWR	Steam generating heavy water reactor				1	
X	Other				2	
TOTAL		435	65	5	138	114

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY

Operator code	Full name	Number of reactors, as of 31 Dec. 2011			
		Operational	Construction	LT shut down	Shut down
AEC/NPPD	ATOMIC ENERGY COMMISSION AND NEBRASKA PUBLIC POWER DISTRICT				
AEP	AMERICAN ELECTRIC POWER COMPANY, INC.	2			1
AmerenUE	AMEREN UE, UNION ELECTRIC COMPANY	1			
ANAV	ASOCIACION NUCLEAR ASCO-VANDELLOS A.I.E. (ENDESA/ID)	3			
ANPP/JSC	JOINT STOCK COMPANY ARMENIAN NPP	1			1
APS	ARIZONA PUBLIC SERVICE CO.	3			
AVR	ARBEITSGEMEINSCHAFT VERSUCHSREAKTOR GMBH	2			1
Axpo AG	KERNKRAFTWERK BEZNAUCH-5312 DOTTINGEN	15			
BE	BRITISH ENERGY				
BHAVINI	BHARATIYA NABHIKIYA VIDYUT NIGAM LIMITED	1			3
BKAB	BARSEBÄCK KRAFT AB	1			
BKW	BKW ENERGIE AG	6		2	
BRUCEPOW	BRUCE POWER				
BV GKN	BV GEMEENSCHAPPELIJKE KERNENERGIECENTRALE NEDERLAND (BV GKN)				1
CEA/EDF	COMMISSARIAT A L'ENERGIE ATOMIQUE (80%)ELECTRICITE DE FRANCE (20%)				1
CEN/SCK	CENTRE D'ETUDE DE L'ENERGIE NUCLEAIRE / STUDIECENTRUM VOOR KERNENERGIE				1
CEZ	CZECH POWER COMPANY, CEZ A.S.	6			
CFE	COMISION FEDERAL DE ELECTRICIDAD	2			
CHUBU	CHUBU ELECTRIC POWER CO., INC.	3			1
CHUGOKU	THE CHUGOKU ELECTRIC POWER CO., INC.				2
CIAE	CHINA INSTITUTE OF ATOMIC ENERGY	1			
CNAT	CENTRALES NUCLEARES ALMARAZ-TRILLO (ID/UFG/ENDESA/HC/NUCLEONOR)	2			
CoP/Quia	CITY OF PIQUA GOVERNMENT	3			1
COGEMA	COMPAGNIE GENERALE DES MATIERES NUCLEAIRES				2
CONSTELL	CONSTELLATION ENERGY NUCLEAR GROUP, LLC	5			
CPC	CONSUMERS POWER CO.				1
CVPA	CAROLINAS-VIRGINIA NUCLEAR POWER ASSOC.				1
CYAPC	CONNECTICUT YANKEE ATOMIC POWER CO.				1
DOE DUQU	DEPARTMENT OF ENERGY AND DUQUESNE LIGHT CO.				1
DOE/PRWR	DOE & PUERTO RICO WATER RESOURCES				1

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY — continued

Operator code	Full Name	Number of reactors, as of 31 Dec. 2011		
		Operational	Construction	Shut down
DOMINION	DOMINION GENERATION	7		1
DPC	DAIRYLAND POWER COOPERATIVE			1
DTEDISON	DETROIT EDISON CO.	1		1
DUKEENER	DUKE ENERGY CORP.	7		
E.ON	E.ON KERNKRAFT GMBH	3		3
EDF	ELECTRICITE DE FRANCE	58	1	8
ELECTRAB	ELECTRABEL M. V. NUCLEAIRE PRODUKTIE	7		
ELETRONU	ELETRONBRAS ELETRONUCLEAR S.A.	2	1	
EMO	ELECTROSTATION MOCHOVCE		2	
ENBW	ENBW KRAFTWERKE AG			1
ENERGYNW	ENERGY NORTHWEST	1		
ENKK	ENBW KERNKRAFT GMBH (SITZ IN OBRIGHEIM)	2		2
ENERGY	ENERGY NUCLEAR OPERATIONS, INC.	12		1
EOS	ENERGIE DE L'OUEST SUISSE			1
EPDC	ELECTRIC POWER DEVELOPMENT CO.,LTD.		1	
EPZ	N.V. ELEKTRICITEITS-PRODUKTIEMAATSCHAPPIJ ZUID-NEDERLAND	1		
ESKOM	ESKOM	2		
EVN	VIETNAM ELECTRICITY			2
EWN	ENERGIEWERKE NORD GMBH			6
EXELON	EXELON GENERATION CO. LLC	17		4
FENOC	FIRST ENERGY NUCLEAR OPERATING CO.	4		
FKA	FORSMARK KRAFTGRUPP AB	3		
FORTUMPH	FORTUM POWER AND HEAT OY (FORMER IVO)	2		
FPL	FLORIDA POWER & LIGHT CO.	4		
FQNP	CNNC FUJIAN FUQING NUCLEAR POWER CO.,LTD		3	3
FSNPC	FUJIAN SANMING NUCLEAR POWER CO.,LTD.			2
GE	GENERAL ELECTRIC			1
GFNPC	GUANGXI FANGCHENGANG NUCLEAR POWER COMPANY LTD		2	
GNP/JVC	GUANGDONG NUCLEAR POWER JOINT VENTURE COMPANY LIMITED (GNP/JVC)	2		
GPU	GENERAL PUBLIC UTILITIES (OWNED BY FIRSTENERGY CORP.)			1
HDR	HEISSDAMPFREAKTOR-BETRIEBSGESELLSCHAFT MBH.			1

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY — continued

Operator code	Full name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	LT shut down	Shut down	Planned
HEPCO	HOKKAIDO ELECTRIC POWER CO., INC.	3				
HIFRENSA	HISPANO-FRANCESA DE ENERGIA NUCLEAR, S.A.				1	
HKG	HOCHTEMPERATUR-KERNKRAFTWERK GMBH				1	
HNPC	HAINAN NUCLEAR POWER COMPANY	2				
HOKURIKU	HOKURIKU ELECTRIC POWER CO.					
HONGYANH	HONGYANHE NUCLEAR POWER COMPANY	1			1	1
HQ	HYDRO QUEBEC					
HSNPC	HUANENG SHANDONG SHIDAOBAY NUCLEAR POWER CO., LTD.	1				1
ID	IBERDROLA, S.A.					
INPP	IGNALINA NUCLEAR POWER PLANT			1		
JAEA	JAPAN ATOMIC ENERGY AGENCY				2	
JAPCO	JAPAN ATOMIC POWER CO.	3			1	2
JAVYS	JADROVA A VYRADOVACIA SPOLOCNOST/NUCLEAR AND DECOMMISSIONING COMPANY, PLC./					
JNPC	JIANGSU NUCLEAR POWER CORPORATION	2			3	
KBG	KERNKRAFTWERK-BETRIEBSGESELLSCHAFT MBH				2	4
KEPCO	KANSAI ELECTRIC POWER CO.	11				
KGB	KERNKRAFTWERKE GUNDRÉMNINGEN BETRIEBSGESELLSCHAFT MBH	2				1
KGG	KERNKRAFTWERK GUNDRÉMNINGEN GMBH	21	5		1	2
KHNP	KOREA HYDRO AND NUCLEAR POWER CO.					
KKB	KERNKRAFTWERK BRUNSÜTTEL GMBH					
KKG	KERNKRAFTWERK GOESGEN-DAENIKEN AG	1				
KKK	KERNKRAFTWERK KRÜMMEL GMBH & CO. OHG					
KKL	KERNKRAFTWERK LEIBSTADT	1				1
KKN	KERNKRAFTWERK NIEDERAICHBACH GMBH					
KLE	KERNKRAFTWERKE LIPPE-EMS GMBH	1				1
KOZNPP	KOZLODUY NPP-PLC	2	2			4
KWG	GEMEINSCHAFTSKERNKRAFTWERK GROHNDE GMBH & CO. OHG	1				
KWL	KERNKRAFTWERK LINGEN GMBH					
KYUSHU	KYUSHU ELECTRIC POWER CO., INC.	6				1
LANPC	LINGAO NUCLEAR POWER COMPANY LTD.	2				
LDNPC	LINGDONG NUCLEAR POWER COMPANY LTD.	2				

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY — continued

Operator code	Full Name	Number of reactors, as of 31 Dec. 2011		
		Operational	Construction	Shut down
LHNPC	LIAONING HONGYANHE NUCLEAR POWER CO. LTD. (LHNPC)		4	
LIPA	LONG ISLAND POWER AUTHORITY			1
LNPC	LIAONIN NUCLEAR POWER COMPANY, LMT.			
LUMINANT	LUMINANT GENERATION COMPANY LLC	2		
MAEC-KAZ	MANGISHLAK ATOMIC ENERGY COMPLEX-KAZATOMPROM, LIMITED LIABILITY COMPANY	3		1
MEL	MAGNOX ELECTRIC LIMITED			23
MTE	MINTOPENERGO OF UKRAINE - MINISTRY OF FUEL AND ENERGY OF UKRAINE			4
MYAPC	MAINE YANKEE ATOMIC POWER CO.	2	1	1
NASA	NUCLEOELECTRICA ARGENTINA S.A.	1		
NBEPIC	NEW BRUNSWICK ELECTRIC POWER COMMISSION			
NDNPC	NINGDE NUCLEAR POWER COMPANY LTD.	4		
NEK	NUKLERANA ELEKTRARNA KRSKO	1		
NEXTERA	NEXTERA ENERGY RESOURCES, LLC	4		
NMHC	NUCLEAR MANAGEMENT CO.			1
NNEG	NATIONAL NUCLEAR ENERGY GENERATING COMPANY <ENERGOATOM>	15	2	
NPICIL	NUCLEAR POWER CORPORATION OF INDIA LTD.	20	6	
NPPDCO	NUCLEAR POWER PRODUCTION & DEVELOPEMENT CO. OF IRAN	1		
NPQJVC	NUCLEAR POWER PLANT QINSHAN JOINT VENTURE COMPANY LTD.	4		
NSP	NORTHERN STATES POWER CO. (SUBSIDIARY OF XCEL ENERGY)	3		
NUCLENOR	NUCLENOR, S.A.	1		
OH	ONTARIO HYDRO			2
OKG	OKG AKTIEBOLAG	3		
OPG	ONTARIO POWER GENERATION	10		
OPPD	OMAHA PUBLIC POWER DISTRICT	1		2
PAEC	PAKISTAN ATOMIC ENERGY COMMISSION	3		
PAKS Zjt	PAKS NUCLEAR POWER PLANT LTD	4	2	
PE	PREUSSELEKTRA KERNKRAFT GMBH&CO KG			
PG&E	PACIFIC GAS AND ELECTRIC COMPANY	2		1
PORTGE	PORTLAND GENERAL ELECTRIC CO.			1
PPL SUSQ	PPL SUSQUEHANNA, LLC	2		1
PROGRESS	PROGRESS ENERGY	5		

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY — continued

Operator code	Full Name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	LT Shut Down	Shut down	Planned
PSCG	PUBLIC SERVICE CO. OF COLORADO	3			1	
PSEG	PSEG NUCLEAR LLC PUBLIC SERVICE ELECTRIC & GAS CO.	1	2			
QNPC	QINSHAN NUCLEAR POWER COMPANY	4				
RAB	RINGHALS AB				1	
RCPA	RURAL COOPERATIVE POWER ASSOC.				5	35
REA	JOINT STOCK COMPANY CONCERN ROSENERGOATOM	33	10		2	
RWE	RWE POWER AG	2			1	
SCE	SOUTHERN CALIFORNIA EDISON CO.	1				
SCE&G	SOUTH CAROLINA ELECTRIC & GAS CO.	4				
SE,plc	SLOVENSKÉ ELEKTRARNE, A.S.	1				
SENA	SOCIETE D'ENERGIE NUCLEAIRE FRANCO-BELGE DES ARDENNES	3			1	
SHIKOKU	SHIKOKU ELECTRIC POWER CO., INC					
SMNPC	SANMEN NUCLEAR POWER CO., LTD.	2			1	2
SMUD	SACRAMENTO MUNICIPAL UTILITY DISTRICT				1	
SNEC	SAXTON NUCLEAR EXPERIMENTAL REACTOR CORPORATION	2				
SNN	SOCIETATEA NATIONALA NUCLEARELECTRICA S.A.					
SNPC	SHANDONG NUCLEAR POWER COMPANY LTD	2				2
SOGIN	SOCIETA GESTIONE IMPANTI NUCLEARI S.P.A.	6			4	
SOUTHERN	SOUTHERN NUCLEAR OPERATING COMPANY, INC.	2				
STP	STP NUCLEAR OPERATING CO.	13				
TEPCO	TOKYO ELECTRIC POWER CO., INC.	4				
TNPC	GUANGDONG TAISHAN NUCLEAR POWER JOINT VENTURE COMPANY LIMITED (TNPC) JOINT VENTURE BETWEEN EDF (30%) AND GUANGDONG NUCLEAR POWER GROUP (CGNPC).	2			4	2
TOHOKU	TOHOKU ELECTRIC POWER CO., INC	6				2
TPC	TAI POWER CO.	2				
TONPC	THE THIRD QINSHAN JOINTED VENTURE COMPANY LTDA.	6				
TVA	TENNESSEE VALLEY AUTHORITY	6			1	
TVO	TEOLLISUUDEN VOIMA OY	2			1	
UFG	UNION FENOSA GENERATION S.A.					1
UKAEA	UNITED KINGDOM ATOMIC ENERGY AUTHORITY					4
VAK	VERSUCHSATOMKRAFTWERK KAHL GMBH					1

TABLE 24. OPERATORS: ABBREVIATIONS AND SUMMARY— continued

Operator code	Full name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	L.T shut down	shut down	Planned
WCNOC	WOLF CREEK NUCLEAR OPERATION CORP.	1				
YAEC	YANKEE ATOMIC ELECTRIC CO.				1	
YJNPC	YANGJIANG NUCLEAR POWER COMPANY		3			3
not specified						39
TOTAL		435	65	5	138	114

TABLE 25. NSSS SUPPLIERS: ABBREVIATIONS AND SUMMARY

NSSS supplier code	Full name	Number of reactors, as of 31 Dec. 2011			
		Operational	Construction	LT shut down	Shut down
A/FW	ASSOCIATION AEC, FRAMATOME ET WESTINGHOUSE				
ABBATOM	ABBATOM (FORMERLY ASEA-ATOM)	7			1
AC	ALLIS CHALMERS				2
ACECOWEN	ACECOWEN (ACEC-COCKERILL-WESTINGHOUSE)	4			3
ACLF	(ACECOWEN - CREUSOT LOIRE - FRAMATOME)	1			
AECL	ATOMIC ENERGY OF CANADA LTD.	9			2
AECL/DAE	ATOMIC ENERGY OF CANADA LTDA AND DEPARTMENT OF ATOMIC ENERGY (INDIA)	1			
AECL/DHI	ATOMIC ENERGY OF CANADA LTD./DOOSAN HEAVY INDUSTRY & CONSTRUCTION	3			
AEE	ATOMENERGOEXPORT	8			6
AEG	ALLGEMEINE ELEKTRICITAETS-GESELLSCHAFT				1
AEG.GE	ALLGEMEINE ELEKTRICITAETS-GESELLSCHAFT, GENERAL ELECTRIC COMPANY (US)				1
AEG.KWU	ALLGEMEINE ELEKTRICITAETS GESELLSCHAFT, KRAFTWERK UNION AG				2
AMIN/GETS	ANSALDO MECCANICO NUCLEARE SPA/GENERAL ELECTRIC TECHNICAL SERVICES CO				1
APC	ATOMIC POWER CONSTRUCTION LTD.	2			2
AREVA	AREVA, 27-29, RUE LE PELETIER, 75433 PARIS CEDEX 09URL: WWW.AREVA.COM	1	4		1
ASE	ATOMSTROYEXPORT	1	4		1
ASEASTAL	ASEA-ATOM/STAL-LAVAL	2			1
ASPALDO	ASPALDO				1
AIEE	ATOMENERGOEXPORT				6
B&W	BABCOCK & WILCOX CO.	7			3
BBK	BROWN BOVERI-KRUPP REAKTORBAU GMBH				1
BBR	BROWN BOVERI REAKTOR GMBH				1
CE	COMBUSTION ENGINEERING CO.				1
CEA	COMMISSARIAT A L'ENERGIE ATOMIQUE	14			1
CGE	CANADIAN GENERAL ELECTRIC	1			1
CNCLNEY	CNIM-CONSTRUCTIONS NAVALES ET INDUSTRIELLES DE MEDITERRANEE CL - CREUSOT LOI				1
CNNG	CHINA NATIONAL NUCLEAR CORPORATION	7			
CZEC	CHINA ZHONGYUAN ENGINEERING CORPORATION				
DFEC	DONGFANG ELECTRIC CORPORATION	2	2		
DHICKAEC	DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO.LTD./KOREA ATOMIC ENERGY RESEARCH INSTITUTE	2	20		13

TABLE 25. NSSS SUPPLIERS: ABBREVIATIONS AND SUMMARY— continued

NSSS supplier code	Full name	Number of reactors, as of 31 Dec. 2011			
		Operational	Construction	LT shut down	Shut down
DHICKOPC	DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO.LTD./KOREA POWER ENGINEERING COMPA	7	5		2
EE/B&WT	THE ENGLISH ELECTRIC CO. LTD./BABCOCK & WILCOX CO./ TAYLOR WOODROW CONSTRU	2		4	1
EL/WEST	ELETTRONUCLEARE ITALIANA / WESTINGHOUSE ELECTRIC CORP.	1		5	
FAEA	FEDERAL ATOMIC ENERGY AGENCY	66		3	
FRAM	FRAMATOMIE	2			
FRAMAGEC	FRAMACECO (FRAMATOME-ACEC-COCKERILL)				
GA	GENERAL ATOMIC CORP.			2	
GAAA	GROUPEMENT ATOMIQUE ALSACIENNE ATLANTIQUE	47		11	
GE	GENERAL ELECTRIC CO.				
GE AEG	GENERAL ELECTRIC COMPANY (US), ALGEMEINE ELEKTRICITAETS- GESELLSCHAFT			1	
GE/GETSC	GENERAL ELECTRIC CO./GENERAL ELECTRIC TECHNICAL SERVICES CO.			1	
GE/T	GENERAL ELECTRIC CO./TOSHIBA CORPORATION	1		1	
GEC	GENERAL ELECTRIC COMPANY (UK)			3	
GETSCO	GENERAL ELECTRIC TECHNICAL SERVICES CO.	2			
GNEPRWRA	GENERAL NUCLEAR ENGINEERING & PUERTO RICO WATER RESOURCES AUTHORITY (US)			1	
GTM	GRANDS TRAVAUX DE MARSEILLE			1	
H/G	HITACHI GE NUCLEAR ENERGY, LTD.		1		
HITACHI	HITACHI LTD.	9		2	
HRB	HOCHTEMPERATUR-REAKTORBAU GMBH			1	
IA	INTERNATOM INTERNATIONALE ATOMREAKTORBAU GMBH			1	
ICL/FE	INTERNATIONAL COMBUSTION LTD. / FAIREY ENGINEERING LTD.			1	
IZ	IZHORSKIYE ZAVODY	3			2
KWU	SIEMENS KRAFTWERK UNION AG	12	1	9	
LEVIVIER	LEVIVIER			2	
MAEC-KAZ	MAEC-KAZATOMPROMMANGSHLAK ATOMIC ENERGY COMPLEX-KAZATOMPROM, LIMITED LIABILITY			1	
MAEP	MINATOMENERGOPROM, MINISTRY OF NUGLEAR POWER AND INDUSTRY		2	2	
MHI	MITSUBISHI HEAVY INDUSTRIES LTD.	20			2
MSM	MINISTRY OF MEDIUM MACHINE BUILDING OF THE USSR (MINSREDMASH)			5	
NSA	NATIONAL GESELLSCHAFT ZUR FÖRDERUNG DER INDUSTRIELLEN ATOMTECHNIK			1	
NNC	NATIONAL NUCLEAR CORPORATION	2			
NPC	NUCLEAR POWER CO. LTD.	6			

TABLE 25. NSSS SUPPLIERS: ABBREVIATIONS AND SUMMARY— continued

NSSS supplier code	Full name	Number of reactors, as of 31 Dec. 2011				
		Operational	Construction	LT shut down	Shut down	Planned
NPICIL	NUCLEAR POWER CORPORATION OF INDIA LTD,VIKRAM SARABHAI BHAVAN, ANUSHAKTI NAG	16	4			
OH/AECL	ONTARIO HYDRO/ATOMIC ENERGY OF CANADA LTD.	16		4		
PAA	PRODUCTION AMALGAMATION 'ATOMMASH', VOLGODONSK	4				
PAIP	PRODUCTION AMALGAMATION ZHORSKY PLANT ATOMMASH,VOLGODONSK,RUSSIA	11				
PPC	PWR POWER PROJECTS LTD	1				
RDM	ROTTERDAMSE DROOGDOK MAATSCHAPPIJ (RDM) IN ROTTERDAM (NL)				1	
ROSATOM	STATE ATOMIC ENERGY CORPORATION ROSATOM	33	10			37
S/KWU	SIEMENS/KRAFTWERK UNION AG	1				
SACM	SOCIETE ALSACIENNE DE CONSTRUCTIONS MECANIQUES				2	
SIEM,KWU	SIEMENS AG, KRAFTWERK UNION AG				2	
SIEMENS	SIEMENS AG, POWER GENERATION -FRG	1	1			1
SKODA	SKODA CONCERN NUCLEAR POWER PLANT WORKS	10	2			1
T/H/F/M	TOSHIBA/HITACHI/FUJI ELECTRIC HOLDINGS/MIITSUBISHI HEAVY INDUSTRIES			1		
TBD	TBD					1
TNPG	THE NUCLEAR POWER GROUP LTD.	5			9	
TOSHIBA	TOSHIBA CORPORATION	14			3	
UEC	UNITED ENGINEERS AND CONTRACTORS					1
UKAEA	UNITED KINGDOM ATOMIC ENERGY AUTHORITY				10	
WH	WESTINGHOUSE ELECTRIC CORPORATION	71	3			4
WH/MIH	WESTINGHOUSE ELECTRIC CORPORATION/MIITSUBISHI HEAVY INDUSTRIES LTD.	1	2			2
not specified			1			49
TOTAL		435	65	5	138	114

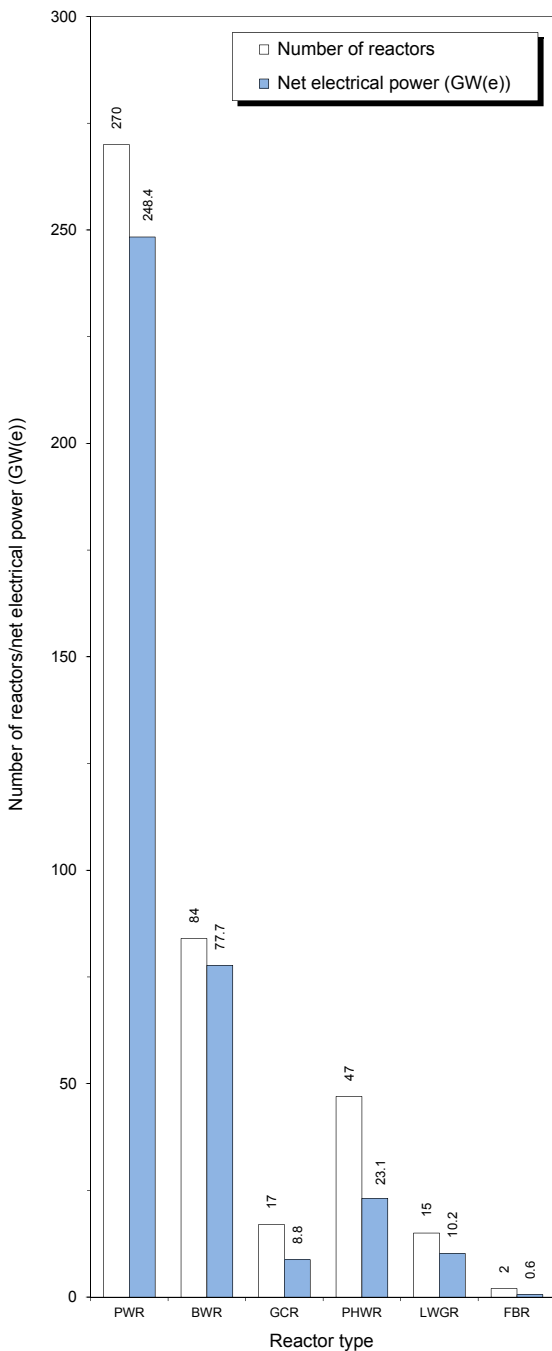


Figure 1. Number of operational reactors by type and net electrical power (as of 31 Dec. 2011).

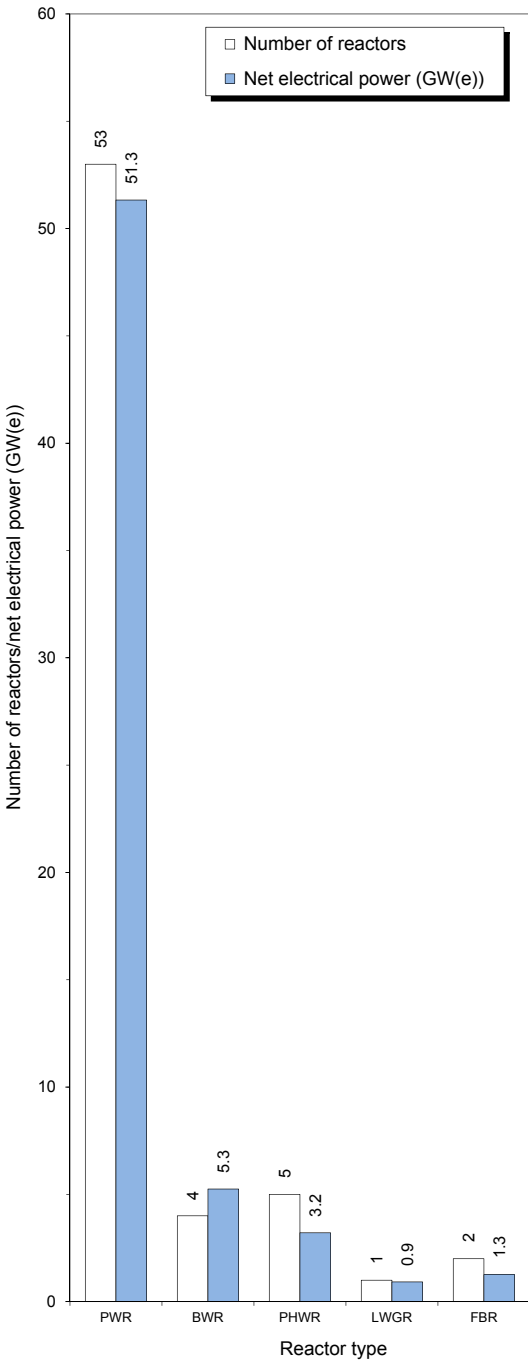


Figure 2. Reactors under construction by type and net electrical power (as of 31 Dec. 2011).

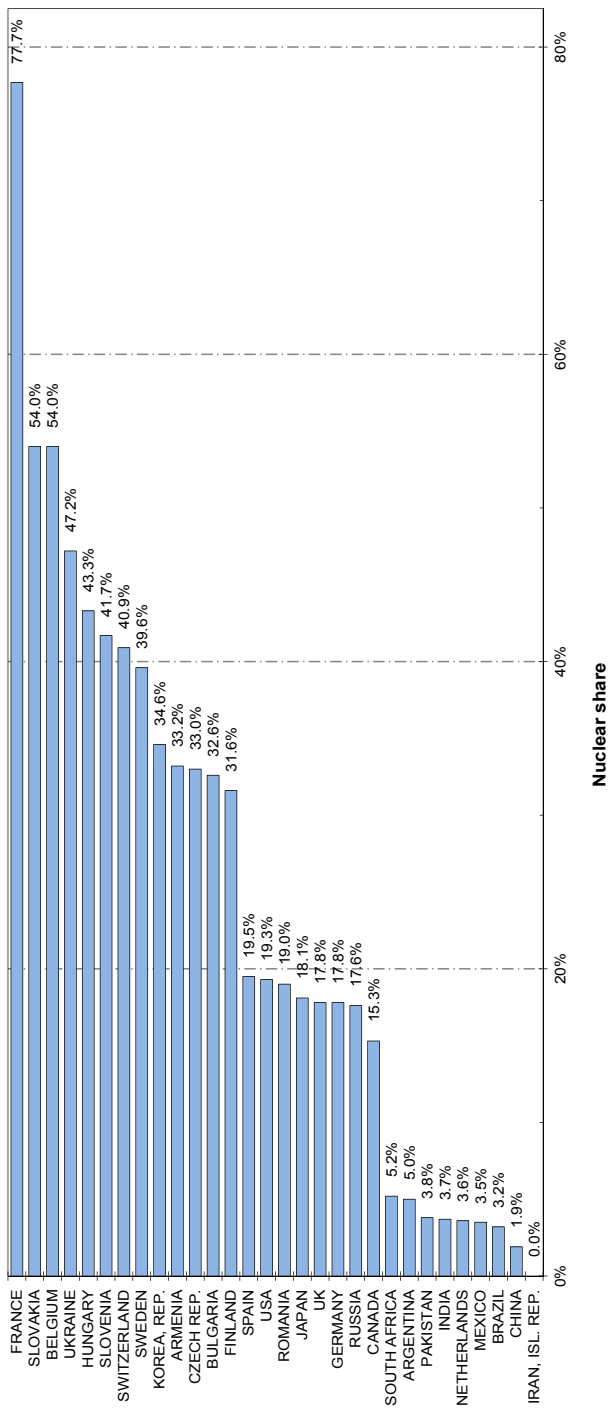


Figure 3. Nuclear share of electricity generation (as of 31 Dec. 2011).

Note: The nuclear share of electricity supplied in Taiwan, China, was 19.0% of the total.

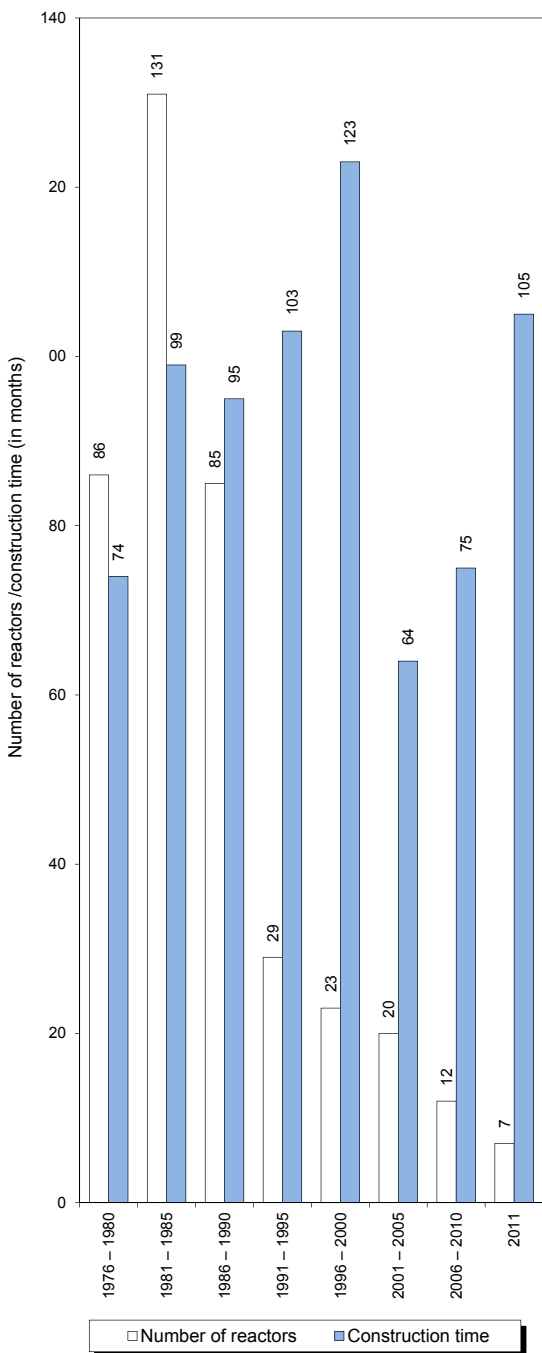


Figure 4. Worldwide median construction time in months (as of 31 Dec. 2011).

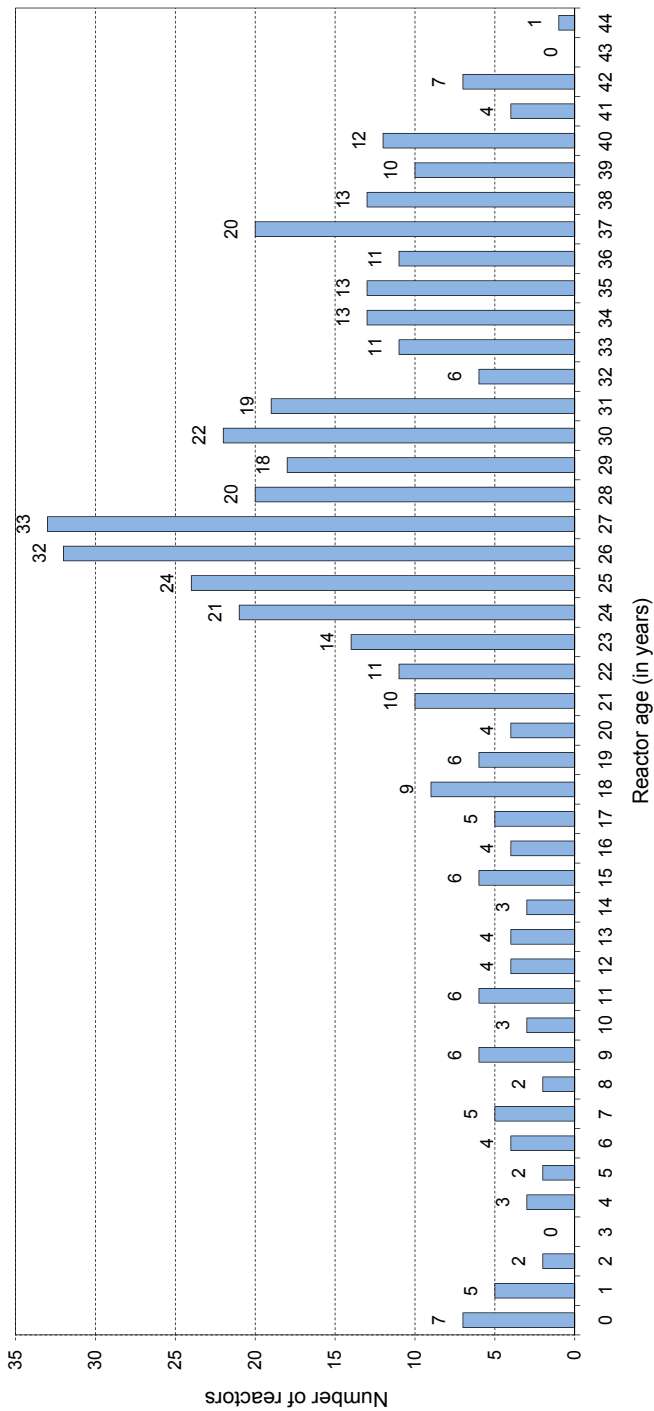


Figure 5. Number of reactors in operation by age (as of 31 Dec. 2011).

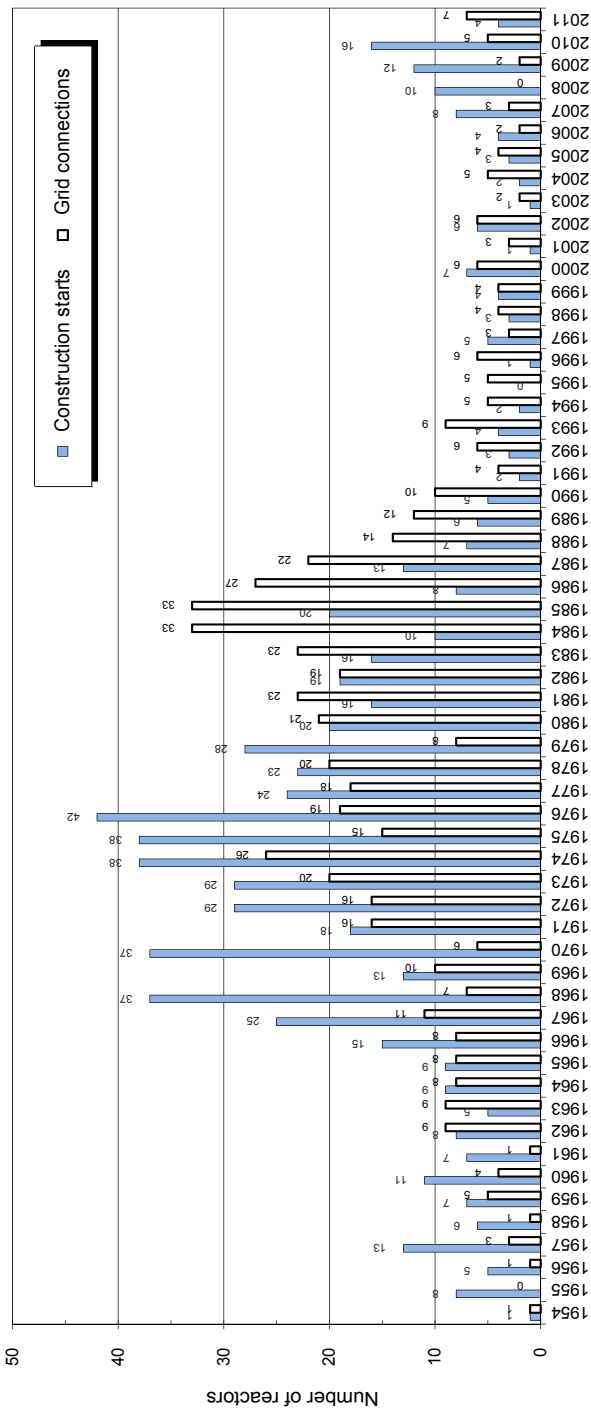


Figure 6. Annual construction starts and connections to the grid, 1954 to 2011.



IAEA

International Atomic Energy Agency

No. 22

Where to order IAEA publications

In the following countries IAEA publications may be purchased from the sources listed below, or from major local booksellers. Payment may be made in local currency or with UNESCO coupons.

AUSTRALIA

DA Information Services, 648 Whitehorse Road, MITCHAM 3132

Telephone: +61 3 9210 7777 • Fax: +61 3 9210 7788

Email: service@dadirect.com.au • Web site: <http://www.dadirect.com.au>

BELGIUM

Jean de Lannoy, avenue du Roi 202, B-1190 Brussels

Telephone: +32 2 538 43 08 • Fax: +32 2 538 08 41

Email: jean.de.lannoy@infoboard.be • Web site: <http://www.jean-de-lannoy.be>

CANADA

Bernan Associates, 4501 Forbes Blvd, Suite 200, Lanham, MD 20706-4346, USA

Telephone: 1-800-865-3457 • Fax: 1-800-865-3450

Email: customercare@bernan.com • Web site: <http://www.bernan.com>

Renouf Publishing Company Ltd., 1-5369 Canotek Rd., Ottawa, Ontario, K1J 9J3

Telephone: +613 745 2665 • Fax: +613 745 7660

Email: order.dept@renoufbooks.com • Web site: <http://www.renoufbooks.com>

CHINA

IAEA Publications in Chinese: China Nuclear Energy Industry Corporation, Translation Section, P.O. Box 2103, Beijing

CZECH REPUBLIC

Suweco CZ, S.R.O., Klecakova 347, 180 21 Praha 9

Telephone: +420 26603 5364 • Fax: +420 28482 1646

Email: nakup@suweco.cz • Web site: <http://www.suweco.cz>

FINLAND

Akateeminen Kirjakauppa, PO BOX 128 (Keskuskatu 1), FIN-00101 Helsinki

Telephone: +358 9 121 41 • Fax: +358 9 121 4450

Email: akatilau@akateeminen.com • Web site: <http://www.akateeminen.com>

FRANCE

Form-Edit, 5, rue Janssen, P.O. Box 25, F-75921 Paris Cedex 19

Telephone: +33 1 42 01 49 49 • Fax: +33 1 42 01 90 90

Email: formedit@formedit.fr • Web site: <http://www.formedit.fr>

Lavoisier SAS, 145 rue de Provigny, 94236 Cachan Cedex

Telephone: + 33 1 47 40 67 02 • Fax +33 1 47 40 67 02

Email: romuald.verrier@lavoisier.fr • Web site: <http://www.lavoisier.fr>

GERMANY

UNO-Verlag, Vertriebs- und Verlags GmbH, Am Hofgarten 10, D-53113 Bonn

Telephone: + 49 228 94 90 20 • Fax: +49 228 94 90 20 or +49 228 94 90 222

Email: bestellung@uno-verlag.de • Web site: <http://www.uno-verlag.de>

HUNGARY

Librotrade Ltd., Book Import, P.O. Box 126, H-1656 Budapest

Telephone: +36 1 257 7777 • Fax: +36 1 257 7472 • Email: books@librotrade.hu

INDIA

Allied Publishers Group, 1st Floor, Dubash House, 15, J. N. Heredia Marg, Ballard Estate, Mumbai 400 001,

Telephone: +91 22 22617926/27 • Fax: +91 22 22617928

Email: alliedpl@vsnl.com • Web site: <http://www.alliedpublishers.com>

Bookwell, 2/72, Nirankari Colony, Delhi 110009

Telephone: +91 11 23268786, +91 11 23257264 • Fax: +91 11 23281315

Email: bookwell@vsnl.net

ITALY

Libreria Scientifica Dott. Lucio di Biasio "AEIOU", Via Coronelli 6, I-20146 Milan

Telephone: +39 02 48 95 45 52 or 48 95 45 62 • Fax: +39 02 48 95 45 48

Email: info@libreriaaeiou.eu • Website: www.libreriaaeiou.eu

JAPAN

Maruzen Company, Ltd., 13-6 Nihonbashi, 3 chome, Chuo-ku, Tokyo 103-0027
Telephone: +81 3 3275 8582 • Fax: +81 3 3275 9072
Email: journal@maruzen.co.jp • Web site: <http://www.maruzen.co.jp>

REPUBLIC OF KOREA

KINS Inc., Information Business Dept. Samho Bldg. 2nd Floor, 275-1 Yang Jae-dong SeoCho-G, Seoul 137-130
Telephone: +02 589 1740 • Fax: +02 589 1746 • Web site: <http://www.kins.re.kr>

NETHERLANDS

De Lindeboom Internationale Publicaties B.V., M.A. de Ruyterstraat 20A, NL-7482 BZ Haaksbergen
Telephone: +31 (0) 53 5740004 • Fax: +31 (0) 53 5729296
Email: books@delindeboom.com • Web site: <http://www.delindeboom.com>

Martinus Nijhoff International, Koraaalrood 50, P.O. Box 1853, 2700 CZ Zoetermeer
Telephone: +31 793 684 400 • Fax: +31 793 615 698
Email: info@nijhoff.nl • Web site: <http://www.nijhoff.nl>

Swets and Zeitlinger b.v., P.O. Box 830, 2160 SZ Lisse
Telephone: +31 252 435 111 • Fax: +31 252 415 888
Email: infoho@swets.nl • Web site: <http://www.swets.nl>

NEW ZEALAND

DA Information Services, 648 Whitehorse Road, MITCHAM 3132, Australia
Telephone: +61 3 9210 7777 • Fax: +61 3 9210 7788
Email: service@dadirect.com.au • Web site: <http://www.dadirect.com.au>

SLOVENIA

Cankarjeva Zalozba d.d., Kopitarjeva 2, SI-1512 Ljubljana
Telephone: +386 1 432 31 44 • Fax: +386 1 230 14 35
Email: import.books@cankarjeva-z.si • Web site: <http://www.cankarjeva-z.si/uvoz>

SPAIN

Díaz de Santos, S.A., c/ Juan Bravo, 3A, E-28006 Madrid
Telephone: +34 91 781 94 80 • Fax: +34 91 575 55 63
Email: compras@diazdesantos.es, carmela@diazdesantos.es, barcelona@diazdesantos.es, julio@diazdesantos.es
Web site: <http://www.diazdesantos.es>

UNITED KINGDOM

The Stationery Office Ltd, International Sales Agency, PO Box 29, Norwich, NR3 1 GN
Telephone (orders): +44 870 600 5552 • (enquiries): +44 207 873 8372 • Fax: +44 207 873 8203
Email (orders): book.orders@tso.co.uk • (enquiries): book.enquiries@tso.co.uk • Web site: <http://www.tso.co.uk>

On-line orders

DELTA Int. Book Wholesalers Ltd., 39 Alexandra Road, Addlestone, Surrey, KT15 2PQ
Email: info@profbooks.com • Web site: <http://www.profbooks.com>

Books on the Environment

Earthprint Ltd., P.O. Box 119, Stevenage SG1 4TP
Telephone: +44 1438748111 • Fax: +44 1438748844
Email: orders@earthprint.com • Web site: <http://www.earthprint.com>

UNITED NATIONS

Dept. I004, Room DC2-0853, First Avenue at 46th Street, New York, N.Y. 10017, USA
(UN) Telephone: +800 253-9646 or +212 963-8302 • Fax: +212 963-3489
Email: publications@un.org • Web site: <http://www.un.org>

UNITED STATES OF AMERICA

Bernan Associates, 4501 Forbes Blvd., Suite 200, Lanham, MD 20706-4346
Telephone: 1-800-865-3457 • Fax: 1-800-865-3450
Email: customercare@bernan.com • Web site: <http://www.bernan.com>

Renouf Publishing Company Ltd., 812 Proctor Ave., Ogdensburg, NY, 13669
Telephone: +888 551 7470 (toll-free) • Fax: +888 568 8546 (toll-free)
Email: order.dept@renoufbooks.com • Web site: <http://www.renoufbooks.com>

Orders and requests for information may also be addressed directly to:

Marketing and Sales Unit, International Atomic Energy Agency

Vienna International Centre, PO Box 100, 1400 Vienna, Austria
Telephone: +43 1 2600 22529 (or 22530) • Fax: +43 1 2600 29302
Email: sales.publications@iaea.org • Web site: <http://www.iaea.org/books>



INTERNATIONAL ATOMIC ENERGY AGENCY
VIENNA

ISBN 978-92-0-132310-1

ISSN 1011-2642